

**COMMUNITY CARE OF WEST VIRGINIA  
BRAXTON COUNTY, WEST VIRGINIA**

**COMMUNITY CARE – FLATWOODS FITOUT**

**ADDENDUM #2**

**NOVEMBER 22, 2022**

**THRASHER PROJECT #060-10268**

TO WHOM IT MAY CONCERN:

A Pre-Bid Conference was held on Tuesday, November 15, 2022, on the above-referenced project, a copy of the sign in sheet is included in this Addendum. The following are clarifications and responses to questions posed by contractors for the above reference project.

**A. GENERAL**

1. If you or any sub-consultants would like to visit the site again Bill Reger will be onsite on Monday November 28, 2022 @ 10am.
2. Questions received about bid and question deadline extension are under review by Owner.

**B. SPECIFICATIONS**

1. ADD 087100 DOOR HARDWARE
2. OMIT Robe Hooks from Specification Section 102800 Toilet, Bath, and Laundry Accessories 2.2 H.

**C. DRAWINGS**

1. REPLACE sheet A1.01 with A1.01R as attached to this Addendum.
  - Added Janitor Closet 212 to plan. JC 212 to have a 2x2 ACT1 ceiling at 9'-0" with a 2'x2' light fixture.
2. REPLACE sheet A6.01 with A6.01R as attached to this Addendum.
  - Added Door Hardware information to schedule.

3. REPLACE sheet I-01, I-02, & I-03 with I-01R, I-02R, & I-03R as attached to this Addendum
  - Revised finishes and details

**D. QUESTIONS AND RESPONSES**

Q1. Can you provide a Door Hardware Specification with a hardware schedule?

A1. Yes, see SPECIFICATIONS #1 and DRAWINGS #2

Q2. Reference Sheet D1.01, Area 3, there is a keyed note #1 at the bottom of the page that points to (2) areas but no walls are shown on the referenced sheet in this area. Please clarify.

A2. Omit keyed note #1 located at the bottom of the page near the exterior door.

If you have any questions or comments, please feel free to contact me at your earliest convenience. As a reminder, bids will be received until 2:00 p.m. on Thursday, December 8, 2022 at Community Care Flatwoods, located at the Flatwoods Factory Stores, 250 Skidmore Ln, Sutton WV 26601. Good luck to everyone and thank you for your interest in the project.

Sincerely,

THE THRASHER GROUP, INC.



Marsha Benson  
Project Manager

## SECTION 087100 – DOOR HARDWARE

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

A. Section includes:

1. Mechanical and electrified door hardware for:
  - a. Swinging doors.
2. Field verification, preparation and modification of existing doors and frames to receive new door hardware.

B. Exclusions: Unless specifically listed in hardware sets, hardware is not specified in this section for:

1. Windows
2. Cabinets (casework), including locks in cabinets
3. Signage
4. Toilet accessories
5. Overhead doors

C. Related Sections:

1. Division 01 Section “Alternates” for alternates affecting this section.
2. Division 07 Section “Joint Sealants” for sealant requirements applicable to threshold installation specified in this section.
3. Division 09 sections for touchup finishing or refinishing of existing openings modified by this section.
4. Division 13 Section “Radiation Protection” for requirements for lead-lining for door hardware at openings indicated to receive radiation protection.
5. Division 26 sections for connections to electrical power system and for low-voltage wiring.
6. Division 28 sections for coordination with other components of electronic access control system.

### 1.3 REFERENCES

#### A. UL - Underwriters Laboratories

1. UL 10B - Fire Test of Door Assemblies
2. UL 10C - Positive Pressure Test of Fire Door Assemblies
3. UL 1784 - Air Leakage Tests of Door Assemblies
4. UL 305 - Panic Hardware

#### B. DHI - Door and Hardware Institute

1. Sequence and Format for the Hardware Schedule
2. Recommended Locations for Builders Hardware
3. Key Systems and Nomenclature

#### C. ANSI - American National Standards Institute

1. ANSI/BHMA A156.1 - A156.29, and ANSI/BHMA A156.31 - Standards for Hardware and Specialties

### 1.4 SUBMITTALS

#### A. General:

1. Submit in accordance with Conditions of Contract and Division 01 requirements.
2. Highlight, encircle, or otherwise specifically identify on submittals deviations from Contract Documents, issues of incompatibility or other issues which may detrimentally affect the Work.
3. Prior to forwarding submittal, comply with procedures for verifying existing door and frame compatibility for new hardware, as specified in PART 3, “EXAMINATION” article, herein.

#### B. Action Submittals:

1. Product Data: Product data including manufacturers’ technical product data for each item of door hardware, installation instructions, maintenance of operating parts and finish, and other information necessary to show compliance with requirements.
2. Riser and Wiring Diagrams: After final approval of hardware schedule, submit details of electrified door hardware, indicating:
  - a. Wiring Diagrams: For power, signal, and control wiring and including:
    - 1) Details of interface of electrified door hardware and building safety and security systems.
    - 2) Schematic diagram of systems that interface with electrified door hardware.
    - 3) Point-to-point wiring.
    - 4) Risers.

3. Samples for Verification: If requested by Architect, submit production sample or sample installations of each type of exposed hardware unit in finish indicated, and tagged with full description for coordination with schedule.
  - a. Samples will be returned to supplier in like-new condition. Units that are acceptable to Architect may, after final check of operations, be incorporated into Work, within limitations of key coordination requirements.
4. Door Hardware Schedule: Submit schedule with hardware sets in vertical format as illustrated by Sequence of Format for the Hardware Schedule as published by the Door and Hardware Institute. Indicate complete designations of each item required for each door or opening, include:
  - a. Door Index; include door number, heading number, and Architects hardware set number.
  - b. Opening Lock Function Spreadsheet: List locking device and function for each opening.
  - c. Type, style, function, size, and finish of each hardware item.
  - d. Name and manufacturer of each item.
  - e. Fastenings and other pertinent information.
  - f. Location of each hardware set cross-referenced to indications on Drawings.
  - g. Explanation of all abbreviations, symbols, and codes contained in schedule.
  - h. Mounting locations for hardware.
  - i. Door and frame sizes and materials.
  - j. Name and phone number for local manufacturer's representative for each product.
  - k. Operational Description of openings with any electrified hardware (locks, exits, electromagnetic locks, electric strikes, automatic operators, door position switches, magnetic holders or closer/holder units, and access control components). Operational description should include how door will operate on egress, ingress, and fire and smoke alarm connection.
    - 1) Submittal Sequence: Submit door hardware schedule concurrent with submissions of Product Data, Samples, and Shop Drawings. Coordinate submission of door hardware schedule with scheduling requirements of other work to facilitate fabrication of other work that is critical in Project construction schedule.
5. Key Schedule:
  - a. After Keying Conference, provide keying schedule listing levels of keying as well as explanation of key system's function, key symbols used and door numbers controlled.
  - b. Use ANSI/BHMA A156.28 "Recommended Practices for Keying Systems" as guideline for nomenclature, definitions, and approach for selecting optimal keying system.
  - c. Provide 3 copies of keying schedule for review prepared and detailed in accordance with referenced DHI publication. Include schematic keying diagram and index each key to unique door designations.

- d. Index keying schedule by door number, keyset, hardware heading number, cross keying instructions, and special key stamping instructions.
  - e. Provide one complete bitting list of key cuts and one key system schematic illustrating system usage and expansion.
    - 1) Forward bitting list, key cuts and key system schematic directly to Owner, by means as directed by Owner.
  - f. Prepare key schedule by or under supervision of supplier, detailing Owner's final keying instructions for locks.
6. Templates: After final approval of hardware schedule, provide templates for doors, frames and other work specified to be factory prepared for door hardware installation.

C. Informational Submittals:

1. Qualification Data: For Supplier, Installer and Architectural Hardware Consultant.
2. Product Certificates for electrified door hardware, signed by manufacturer:
  - a. Certify that door hardware approved for use on types and sizes of labeled fire-rated doors complies with listed fire-rated door assemblies.
3. Certificates of Compliance:
  - a. Certificates of compliance for fire-rated hardware and installation instructions if requested by Architect or Authority Having Jurisdiction.
  - b. Installer Training Meeting Certification: Letter of compliance, signed by Contractor, attesting to completion of installer training meeting specified in "QUALITY ASSURANCE" article, herein.
  - c. Electrified Hardware Coordination Conference Certification: Letter of compliance, signed by Contractor, attesting to completion of electrified hardware coordination conference, specified in "QUALITY ASSURANCE" article, herein.
4. Product Test Reports: For compliance with accessibility requirements, based on evaluation of comprehensive tests performed by manufacturer and witnessed by qualified testing agency, for door hardware on doors located in accessible routes.
5. Warranty: Special warranty specified in this Section.

D. Closeout Submittals:

1. Operations and Maintenance Data : Provide in accordance with Division 01 and include:
  - a. Complete information on care, maintenance, and adjustment; data on repair and replacement parts, and information on preservation of finishes.
  - b. Catalog pages for each product.

- c. Name, address, and phone number of local representative for each manufacturer.
- d. Parts list for each product.
- e. Final approved hardware schedule, edited to reflect conditions as-installed.
- f. Final keying schedule
- g. Copies of floor plans with keying nomenclature
- h. As-installed wiring diagrams for each opening connected to power, both low voltage and 110 volts.
- i. Copy of warranties including appropriate reference numbers for manufacturers to identify project.

## 1.5 QUALITY ASSURANCE

- A. Product Substitutions: Comply with product requirements stated in Division 01 and as specified herein.
  1. Where specific manufacturer's product is named and accompanied by "No Substitute," including make or model number or other designation, provide product specified. (Note: Certain products have been selected for their unique characteristics and particular project suitability.)
    - a. Where no additional products or manufacturers are listed in product category, requirements for "No Substitute" govern product selection.
  2. Where products indicate "acceptable manufacturers" or "acceptable manufacturers and products", provide product from specified manufacturers, subject to compliance with specified requirements and "Single Source Responsibility" requirements stated herein.
- B. Supplier Qualifications and Responsibilities: Recognized architectural hardware supplier with record of successful in-service performance for supplying door hardware similar in quantity, type, and quality to that indicated for this Project and that provides certified Architectural Hardware Consultant (AHC) available to Owner, Architect, and Contractor, at reasonable times during the Work for consultation.
  1. Warehousing Facilities: In Project's vicinity.
  2. Scheduling Responsibility: Preparation of door hardware and keying schedules.
  3. Engineering Responsibility: Preparation of data for electrified door hardware, including Shop Drawings, based on testing and engineering analysis of manufacturer's standard units in assemblies similar to those indicated for this Project.
  4. Coordination Responsibility: Coordinate installation of electronic security hardware with Architect and electrical engineers and provide installation and technical data to Architect and other related subcontractors.
    - a. Upon completion of electronic security hardware installation, inspect and verify that all components are working properly.

- C. Installer Qualifications: Qualified tradesmen, skilled in application of commercial grade hardware with record of successful in-service performance for installing door hardware similar in quantity, type, and quality to that indicated for this Project.
- D. Architectural Hardware Consultant Qualifications: Person who is experienced in providing consulting services for door hardware installations that are comparable in material, design, and extent to that indicated for this Project and meets these requirements:
  - 1. For door hardware, DHI-certified, Architectural Hardware Consultant (AHC).
  - 2. Can provide installation and technical data to Architect and other related subcontractors.
  - 3. Can inspect and verify components are in working order upon completion of installation.
  - 4. Capable of producing wiring diagrams.
  - 5. Capable of coordinating installation of electrified hardware with Architect and electrical engineers.
- E. Single Source Responsibility: Obtain each type of door hardware from single manufacturer.
  - 1. Provide electrified door hardware from same manufacturer as mechanical door hardware, unless otherwise indicated.
  - 2. Manufacturers that perform electrical modifications and that are listed by testing and inspecting agency acceptable to authorities having jurisdiction are acceptable.
- F. Fire-Rated Door Openings: Provide door hardware for fire-rated openings that complies with NFPA 80 and requirements of authorities having jurisdiction. Provide only items of door hardware that are listed and are identical to products tested by Underwriters Laboratories, Intertek Testing Services, or other testing and inspecting organizations acceptable to authorities having jurisdiction for use on types and sizes of doors indicated, based on testing at positive pressure and according to NFPA 252 or UL 10C and in compliance with requirements of fire-rated door and door frame labels.
- G. Smoke- and Draft-Control Door Assemblies: Where smoke- and draft-control door assemblies are required, provide door hardware that meets requirements of assemblies tested according to UL 1784 and installed in compliance with NFPA 105.
  - 1. Air Leakage Rate: Maximum air leakage of 0.3 cfm/sq. ft. (3 cu. m per minute/sq. m) at tested pressure differential of 0.3-inch wg (75 Pa) of water.
- H. Electrified Door Hardware: Listed and labeled as defined in NFPA 70, Article 100, by testing agency acceptable to authorities having jurisdiction.
- I. Means of Egress Doors: Latches do not require more than 15 lbf (67 N) to release latch. Locks do not require use of key, tool, or special knowledge for operation.



- J. Accessibility Requirements: For door hardware on doors in an accessible route, comply with governing accessibility regulations cited in “REFERENCES” article, herein.
1. Provide operating devices that do not require tight grasping, pinching, or twisting of wrist and that operate with force of not more than 5 lbf (22.2 N).
  2. Maximum opening-force requirements:
    - a. Interior, Non-Fire-Rated Hinged Doors: 5 lbf (22.2 N) applied perpendicular to door.
    - b. Sliding or Folding Doors: 5 lbf (22.2 N) applied parallel to door at latch.
    - c. Fire Doors: Minimum opening force allowable by authorities having jurisdiction.
  3. Bevel raised thresholds with slope of not more than 1:2. Provide thresholds not more than 1/2 inch (13 mm) high.
  4. Adjust door closer sweep periods so that, from open position of 70 degrees, door will take at least 3 seconds to move to 3 inches (75 mm) from latch, measured to leading edge of door.
- K. Keying Conference: Conduct conference at Project site to comply with requirements in Division 01.
1. Attendees: Owner, Contractor, Architect, Installer and Supplier’s Architectural Hardware Consultant.
  2. Incorporate keying conference decisions into final keying schedule after reviewing door hardware keying system including:
    - a. Function of building, flow of traffic, purpose of each area, degree of security required, and plans for future expansion.
    - b. Preliminary key system schematic diagram.
    - c. Requirements for key control system.
    - d. Requirements for access control.
    - e. Address for delivery of keys.
- L. Coordination Conferences:
1. Installation Coordination Conference: Prior to hardware installation, schedule and hold meeting to review questions or concerns related to proper installation and adjustment of door hardware.
    - a. Attendees: Door hardware supplier, door hardware installer, Contractor.
    - b. After meeting, provide letter of compliance to Architect, indicating when meeting was held and who was in attendance.
  2. Electrified Hardware Coordination Conference: Prior to ordering electrified hardware, schedule and hold meeting to coordinate door hardware with security, electrical, doors and frames, and other related suppliers.

- a. Attendees: electrified door hardware supplier, doors and frames supplier, electrified door hardware installer, electrical subcontractor, Owner, Architect and Contractor.
- b. After meeting, provide letter of compliance to Architect, indicating when coordination conference was held and who was in attendance.

## 1.6 DELIVERY, STORAGE, AND HANDLING

- A. Inventory door hardware on receipt and provide secure lock-up for hardware delivered to Project site.
- B. Tag each item or package separately with identification coordinated with final door hardware schedule, and include installation instructions, templates, and necessary fasteners with each item or package.
  1. Deliver each article of hardware in manufacturer's original packaging.
- C. Project Conditions:
  1. Maintain manufacturer-recommended environmental conditions throughout storage and installation periods.
  2. Provide secure lock-up for door hardware delivered to Project, but not yet installed. Control handling and installation of hardware items so that completion of Work will not be delayed by hardware losses both before and after installation.
- D. Protection and Damage:
  1. Promptly replace products damaged during shipping.
  2. Handle hardware in manner to avoid damage, marring, or scratching. Correct, replace or repair products damaged during Work.
  3. Protect products against malfunction due to paint, solvent, cleanser, or any chemical agent.
- E. Deliver keys to manufacturer of key control system for subsequent delivery to Owner.
- F. Deliver keys and permanent cores to Owner by registered mail or overnight package service.

## 1.7 COORDINATION

- A. Coordinate layout and installation of floor-recessed door hardware with floor construction. Cast anchoring inserts into concrete. Concrete, reinforcement, and formwork requirements are specified in Division 03.
- B. Installation Templates: Distribute for doors, frames, and other work specified to be factory prepared. Check Shop Drawings of other work to confirm that adequate

- provisions are made for locating and installing door hardware to comply with indicated requirements.
- C. Security: Coordinate installation of door hardware, keying, and access control with Owner's security consultant.
  - D. Electrical System Roughing-In: Coordinate layout and installation of electrified door hardware with connections to power supplies and building safety and security systems.
  - E. Existing Openings: Where hardware components are scheduled for application to existing construction or where modifications to existing door hardware are required, field verify existing conditions and coordinate installation of door hardware to suit opening conditions and to provide proper door operation.
  - F. Direct shipments not permitted, unless approved by Contractor.

## 1.8 WARRANTY

- A. Special Warranty: Manufacturer's standard form in which manufacturer agrees to repair or replace components of door hardware that fail in materials or workmanship within specified warranty period.
  - 1. Warranty Period: Years from date of Substantial Completion, for durations indicated.
    - a. Closers:
      - 1) Mechanical: 10 years. Electrified: 2 years.
    - b. Automatic Operators: 1 year.
    - c. Exit Devices:
      - 1) Mechanical: 3 years.
      - 2) Electrified: 1 year.
    - d. Locksets:
      - 1) Mechanical: 3 years.
      - 2) Electrified: 1 year.
    - e. Continuous Hinges: Lifetime warranty
  - 2. Warranty does not cover damage or faulty operation due to improper installation, improper use or abuse.

## 1.9 MAINTENANCE

- A. Maintenance Tools:

1. Furnish complete set of special tools required for maintenance and adjustment of hardware, including changing of cylinders.

## PART 2 - PRODUCTS

### 2.1 MANUFACTURERS

- A. The Owner requires use of certain products for their unique characteristics and particular project suitability to insure continuity of existing and future performance and maintenance standards. After investigating available product offerings Awarding Authority has elected to prepare proprietary specifications. These products are specified with the notation: "No Substitute."
  1. Where "No Substitute" is noted, submittals and substitution requests for other products will not be considered.
- B. Approval of manufacturers and/or products other than those listed as "Scheduled Manufacturer" or "Acceptable Manufacturers" in the individual article for the product category shall be in accordance with QUALITY ASSURANCE article, herein.
- C. Approval of products from manufacturers indicated in "Acceptable Manufacturers" is contingent upon those products providing all functions and features and meeting all requirements of scheduled manufacturer's product.
- D. Hand of Door: Drawings show direction of slide, swing, or hand of each door leaf. Furnish each item of hardware for proper installation and operation of door movement as shown.
- E. Where specified hardware is not adaptable to finished shape or size of members requiring hardware, furnish suitable types having same operation and quality as type specified, subject to Architect's approval.

### 2.2 MATERIALS

- A. Fasteners
  1. Provide hardware manufactured to conform to published templates, generally prepared for machine screw installation.
  2. Furnish screws for installation with each hardware item. Finish exposed (exposed under any condition) screws to match hardware finish, or, if exposed in surfaces of other work, to match finish of this other work including prepared for paint surfaces to receive painted finish.
  3. Provide concealed fasteners for hardware units exposed when door is closed except when no standard units of type specified are available with concealed

fasteners. Do not use thru-bolts for installation where bolt head or nut on opposite face is exposed in other work unless thru-bolts are required to fasten hardware securely. Review door specification and advise Architect if thru-bolts are required.

4. Install hardware with fasteners provided by hardware manufacturer.
- B. Modification and Preparation of Existing Doors: Where existing door hardware is indicated to be removed and reinstalled.
1. Provide necessary fillers, Dutchmen, reinforcements, and fasteners, compatible with existing materials, as required for mounting new opening hardware and to cover existing door and frame preparations.
  2. Use materials which match materials of adjacent modified areas.
  3. When modifying existing fire-rated openings, provide materials permitted by NFPA 80 as required to maintain fire-rating.
- C. Provide screws, bolts, expansion shields, drop plates and other devices necessary for hardware installation.
1. Where fasteners are exposed to view: Finish to match adjacent door hardware material.

## 2.3 HINGES

- A. Provide five-knuckle, ball bearing hinges.
1. Manufacturers and Products:
    - a. Scheduled Manufacturer and Product: Ives 5BB series
    - b. Acceptable Manufacturers and Products: Hager BB series, McKinney TA/T4A series, Stanley FBB Series
- B. Requirements:
1. 1-3/4 inch (44 mm) thick doors, up to and including 36 inches (914 mm) wide:
    - a. Exterior: Standard weight, bronze or stainless steel, 4-1/2 inches (114 mm) high
    - b. Interior: Standard weight, steel, 4-1/2 inches (114 mm) high
  2. 1-3/4 inch (44 mm) thick doors over 36 inches (914 mm) wide:
    - a. Exterior: Heavy weight, bronze/stainless steel, 5 inches (127 mm) high
    - b. Interior: Heavy weight, steel, 5 inches (127 mm) high
  3. 2 inches or thicker doors:
    - a. Exterior: Heavy weight, bronze or stainless steel, 5 inches (127 mm) high
    - b. Interior: Heavy weight, steel, 5 inches (127 mm) high

4. Provide three hinges per door leaf for doors 90 inches (2286 mm) or less in height, and one additional hinge for each 30 inches (762 mm) of additional door height.
5. Where new hinges are specified for existing doors or existing frames, provide new hinges of identical size to hinge preparation present in existing door or existing frame.
6. Hinge Pins: Except as otherwise indicated, provide hinge pins as follows:
  - a. Steel Hinges: Steel pins
  - b. Non-Ferrous Hinges: Stainless steel pins
  - c. Out-Swinging Exterior Doors: Non-removable pins
  - d. Out-Swinging Interior Lockable Doors: Non-removable pins
  - e. Interior Non-lockable Doors: Non-rising pins
7. Width of hinges: 4-1/2 inches (114 mm) at 1-3/4 inch (44 mm) thick doors, and 5 inches (127 mm) at 2 inches (51 mm) or thicker doors. Adjust hinge width as required for door, frame, and wall conditions to allow proper degree of opening.
8. Doors 36 inches (914 mm) wide or less furnish hinges 4-1/2 inches (114 mm) high; doors greater than 36 inches (914 mm) wide furnish hinges 5 inches (127 mm) high, heavy weight or standard weight as specified.
9. Provide hinges with electrified options as scheduled in the hardware sets. Provide with sufficient number and wire gage to accommodate electric function of specified hardware. Locate electric hinge at second hinge from bottom or nearest to electrified locking component.
10. Provide mortar guard for each electrified hinge specified, unless specified in hollow metal frame specification.
11. Provide spring hinges where specified. Provide two spring hinges and one bearing hinge per door leaf for doors 90 inches (2286 mm) or less in height. Provide one additional bearing hinge for each 30 inches (762 mm) of additional door height.

## 2.4 CONTINUOUS HINGES

### A. Aluminum Geared

1. Manufacturers:
  - a. Scheduled Manufacturer: Ives.
  - b. Acceptable Manufacturers: Markar, Stanley.
2. Requirements:
  - a. Provide aluminum geared continuous hinges conforming to ANSI/BHMA A156.25, Grade 2.
  - b. Provide aluminum geared continuous hinges, where specified in the hardware sets, fabricated from 6063-T6 aluminum, with 0.25-inch (6 mm) diameter Teflon coated stainless steel hinge pin.

- c. Provide split nylon bearings at each hinge knuckle for quiet, smooth, self-lubricating operation.
- d. Provide hinges capable of supporting door weights up to 450 pounds, and successfully tested for 1,500,000 cycles.
- e. On fire-rated doors, provide aluminum geared continuous hinges that are classified for use on rated doors by testing agency acceptable to authority having jurisdiction.
- f. Provide aluminum geared continuous hinges with electrified option scheduled in the hardware sets. Provide with sufficient number and wire gage to accommodate electric function of specified hardware.
- g. Install hinges with fasteners supplied by manufacturer.
- h. Provide hinges with symmetrical hole pattern.

## 2.5 FLUSH BOLTS

### A. Manufacturers:

1. Scheduled Manufacturer: Ives
2. Acceptable Manufacturers: Burns, Rockwood

### B. Requirements:

1. Provide automatic, constant latching, and manual flush bolts with forged bronze or stainless steel face plates, extruded brass levers, and with wrought brass guides and strikes. Provide 12 inch (305 mm) steel or brass rods at doors up to 90 inches (2286 mm) in height. For doors over 90 inches (2286 mm) in height increase top rods by 6 inches (152 mm) for each additional 6 inches (152 mm) of door height. Provide dust-proof strikes at each bottom flush bolt.

## 2.6 CYLINDRICAL LOCKS – GRADE 1

### A. Manufacturers and Products:

1. Scheduled Manufacturer and Product: Falcon T Series
2. Acceptable Manufacturers and Products: Corbin-Russwin CL3300 series, Best 93K

### B. Requirements:

1. Provide cylindrical locks conforming to ANSI/BHMA A156.2 Series 4000, Grade 1. Cylinders: Refer to “KEYING” article, herein.
2. Provide locks with standard 2-3/4 inches (70 mm) backset, unless noted otherwise, with a 1/2 inch (13 mm) latch throw. Provide proper latch throw for UL listing at pairs.
3. Provide locksets with separate anti-rotation thru-bolts, and no exposed screws.

4. Provide independently operating levers with two external return spring cassettes mounted under roses to prevent lever sag.
5. Provide standard ASA strikes unless extended lip strikes are necessary to protect trim.
6. Provide electrified options as scheduled in the hardware sets.
7. Lever Trim: Solid cast levers without plastic inserts, and wrought roses on both sides.
  - a. Lever Design: Falcon D-Dane.
  - b. Tactile Warning (Knurling): Where required by authority having jurisdiction. Provide on levers on exterior (secure side) of doors serving rooms considered to be hazardous.

## 2.7 MORTISE LOCKS

### A. Manufacturers and Products:

1. Scheduled Manufacturer and Product: Falcon MA series.
2. Acceptable Manufacturers: Best 45K series, Sargent 8200 series.

### B. Requirements:

1. Provide mortise locks conforming to ANSI/BHMA A156.13 Series 1000, Grade 1, and UL Listed for 3 hour fire doors.
2. Provide locks manufactured from heavy gauge steel, containing components of steel with a zinc dichromate plating for corrosion resistance.
3. Provide lock case that is multi-function and field reversible for handing without opening case. Cylinders: Refer to “KEYING” article, herein.
4. Provide locks with standard 2-3/4 inches (70 mm) backset with full 3/4 inch (19 mm) throw stainless steel mechanical anti-friction latchbolt. Provide deadbolt with full 1 inch (25 mm) throw, constructed of stainless steel.
5. Provide standard ASA strikes unless extended lip strikes are necessary to protect trim.
6. Provide electrified options as scheduled in the hardware sets. Where scheduled, provide a request to exit (RX) switch that is actuated with rotation of inside lever.
7. Lever Trim: Solid brass, bronze, or stainless steel, cast or forged in design specified, with wrought roses and external lever spring cages. Provide thru-bolted levers with 2-piece spindles.
  - a. Lever Design: Falcon Dane.
  - b. Tactile Warning (Knurling): Where required by authority having jurisdiction. Provide on levers on exterior (secure side) of doors serving rooms considered to be hazardous.



## 2.8 EXIT DEVICES

### A. Manufacturers and Products:

1. Scheduled Manufacturer and Product: Falcon 24/25 series with deadlatching
2. Acceptable Manufacturers and Products: Sargent 80 series with deadlatching, Precision Apex series

### B. Requirements:

1. Provide exit devices tested to ANSI/BHMA A156.3 Grade 1, and UL listed for Panic Exit or Fire Exit Hardware. Cylinders: Refer to “KEYING” article, herein.
2. Exit Devices: Touchpad type, fabricated of brass, bronze, stainless steel, or aluminum, plated to standard architectural finishes to match balance of door hardware.
3. Touchpad: Extend minimum of one half of door width. Match exit device finish or provide compatible finish. Provide compression springs in devices, latches, and outside trims or controls, tension springs also acceptable.
4. Provide devices with deadlatching feature for security and for future addition of alarm kits and other electrical requirements.
5. Provide manufacturer's standard strikes.
6. Provide exit devices cut to door width and height. Locate exit devices at height recommended by exit device manufacturer, allowable by governing building codes, and approved by Architect.
7. Mount mechanism case flush on face of doors, or provide spacers to fill gaps behind devices. Where glass trim or molding projects off face of door, provide glass bead kits.
8. Provide cylinder dogging at non-fire-rated exit devices.
9. Removable Mullions: 2 inches (51 mm) x 3 inches (76 mm) steel tube. Where scheduled as keyed removable mullion, provide type that can be removed by use of a keyed cylinder, which is self-locking when re-installed.
10. Where lever handles are specified as outside trim for exit devices, provide heavy-duty lever trims with forged or cast escutcheon plates. Provide vandal-resistant levers that will travel to 90-degree down position when more than 35 pounds of torque are applied, and which can easily be re-set.
  - a. Lever Style: Match lever style of locksets.
  - b. Tactile Warning (Knurling): Where required by authority having jurisdiction. Provide on levers on exterior (secure side) of doors serving rooms considered to be hazardous.
11. Provide UL labeled fire exit hardware for fire rated openings.
12. Field drill weep holes per manufacturer’s recommendation for exit devices used in full exterior application, highly corrosive areas, and where noted in the hardware sets.
13. Provide electrified options as scheduled in the hardware sets.

## 2.9 POWER SUPPLIES

### A. Manufacturers and Products:

1. Scheduled Manufacturer and Product: Schlage or Von Duprin PS900 series
2. Acceptable Manufacturers and Products: Precision ELR series, Sargent 3500 series, Dynalock 5000 series, Folger Adam FABPS series, Securitron BPS series, Security Door Controls 600 series

### B. Requirements:

1. Provide power supplies, recommended and approved by manufacturer of electrified locking component, for operation of electrified locks, electrified exit devices, magnetic locks, electric strikes, and other components requiring power supply.
2. Provide appropriate quantity of power supplies necessary for proper operation of electrified locking components as recommended by manufacturer of electrified locking components with consideration for each electrified component using power supply, location of power supply, and approved wiring diagrams. Locate power supplies as directed by Architect.
3. Provide regulated and filtered 24 VDC power supply , and UL class 2 listed.
4. Options:
  - a. Provide power supply, where specified, with internal capability of charging sealed backup batteries 24 VDC, in addition to operating DC load.
  - b. Provide sealed batteries for battery back-up at each power supply where specified.
  - c. Provide keyed power supply cabinet.
5. Provide power supply in an enclosure, complete, and requiring 120VAC to fused input.
6. Provide power supply with emergency release terminals, where specified, that allow release of all devices upon activation of fire alarm system complete with fire alarm input for initiating “no delay” exiting mode.

## 2.10 CYLINDERS

### A. Manufacturers:

1. Scheduled Manufacturer: Falcon
2. Acceptable Manufacturers: Best, Corbin-Russwin

### B. Requirements:

1. Provide cylinders/cores, from the same manufacturer of locksets, compliant with ANSI/BHMA A156.5; latest revision, Section 12, Grade 1; permanent cylinders; cylinder face finished to match lockset, manufacturer’s series as indicated. Refer to “KEYING” article, herein.

2. Provide cylinders in the below-listed configuration(s), distributed throughout the Project as indicated.
  - a. High Security: dual-locking cylinder with permanent core requiring, patented keyway.
  - b. Security: dual-locking cylinder with **interchangeable** core requiring restricted, patented keyway.
  - c. Conventional cylinder with **interchangeable** core with open keyway.
3. Patent Protection: Cylinders/cores requiring use of restricted, patented keys, patent-protected.
4. Security Cylinders: Where indicated, provide cylinders/cores with “dual-locking mechanism” with interlocking finger pin(s) to check for patented features on keys.
5. Nickel silver bottom pins.
6. Temporary Construction Cylinder Keying.
  - a. Owner or Owner’s Representative will void operation of temporary construction keys.
7. Replaceable Construction Cores..
  - a. Provide temporary construction cores replaceable by permanent cores, furnished in accordance with the following requirements.
    - 1) 12 construction change (day) keys.

## 2.11 KEYING

- A. Provide a factory registered keying system, complying with guidelines in ANSI/BHMA A156.28, incorporating decisions made at keying conference.
- B. Requirements:
  - a. All Locks to be keyed into the owner existing Master Key System as directed by the owner.
2. Provide keys with the following features.
  - a. Material: Solid nickel plated
3. Identification:
  - a. Mark permanent cylinders/cores and keys with applicable blind code per DHI publication “Keying Systems and Nomenclature” for identification. Blind code marks shall not include actual key cuts.
  - b. Identification stamping provisions must be approved by the Architect and Owner.
  - c. Failure to comply with stamping requirements shall be cause for replacement of keys involved at no additional cost to Owner.

- d. Forward permanent cylinders/cores to Owner, separately from keys, by means as directed by Owner.
4. Quantity: Furnish in the following quantities.
  - a. Change (Day) Keys: 3 per cylinder/core.
  - b. Permanent Control Keys: 3.
  - c. Master Keys: 6.
  - d. Unused balance of key blanks shall be furnished to Owner with the cut keys.
  - e. Extra Keys:
    - 1) **6** Construction Keys

## 2.12 KEY CONTROL SYSTEM

### A. Manufacturers:

1. Scheduled Manufacturer: Telkee
2. Acceptable Manufacturers: HPC, Lund

### B. Requirements:

1. Provide key control system, including envelopes, labels, tags with self-locking key clips, receipt forms, 3-way visible card index, temporary markers, permanent markers, and standard metal cabinet, all as recommended by system manufacturer, with capacity for 150% of number of locks required for Project.
  - a. Provide complete cross index system set up by hardware supplier, and place keys on markers and hooks in cabinet as determined by final key schedule.
  - b. Provide hinged-panel type cabinet for wall mounting.

## 2.13 DOOR CLOSERS

### A. Manufacturers and Products:

1. Scheduled Manufacturer and Product: Falcon SC70 series.
2. Acceptable Manufacturers and Products: Norton 7500 series, Sargent 350 series.

### B. Requirements:

1. Provide door closers conforming to ANSI/BHMA A156.4 Grade 1 requirements by BHMA certified independent testing laboratory. ISO 9000 certify closers. Stamp units with date of manufacture code.
2. Provide door closers with fully hydraulic, full rack and pinion action with aluminum cylinder.
3. Closer Body: 1-1/2 inch (38 mm) diameter with 5/8 inch (16 mm) diameter heat-treated pinion journal.

4. Hydraulic Fluid: Fireproof, passing requirements of UL10C, and requiring no seasonal closer adjustment for temperatures ranging from 120 degrees F to -30 degrees F.
5. Spring Power: Continuously adjustable over full range of closer sizes, and providing reduced opening force as required by accessibility codes and standards.
6. Hydraulic Regulation: By tamper-proof, non-critical valves, with separate adjustment for latch speed, general speed, and backcheck.
7. Pressure Relief Valve (PRV) Technology: Not permitted.
8. Provide special templates, drop plates, mounting brackets, or adapters for arms as required for details, overhead stops, and other door hardware items interfering with closer mounting.

## 2.14 DOOR TRIM

### A. Manufacturers:

1. Scheduled Manufacturer: Ives
2. Acceptable Manufacturers: Burns, Rockwood

### B. Requirements:

1. Provide push plates 4 inches (102 mm) wide by 16 inches (406 mm) high by 0.050 inch (1 mm) thick and beveled 4 edges. Where width of door stile prevents use of 4 inches (102 mm) wide plate, adjust width to fit.
2. Provide push bars of solid bar stock, diameter and length as scheduled. Provide push bars of sufficient length to span from center to center of each stile. Where required, mount back to back with pull.
3. Provide offset pulls of solid bar stock, diameter and length as scheduled. Where required, mount back to back with push bar.
4. Provide flush pulls as scheduled. Where required, provide back-to-back mounted model.
5. Provide pulls of solid bar stock, diameter and length as scheduled. Where required, mount back to back with push bar.
6. Provide pull plates 4 inches (102 mm) wide by 16 inches (406 mm) high by 0.050 inch (1 mm) thick, beveled 4 edges, and prepped for pull. Where width of door stile prevents use of 4 inches (102 mm) wide plate, adjust width to fit.
7. Provide wire pulls of solid bar stock, diameter and length as scheduled.
8. Provide decorative pulls as scheduled. Where required, mount back to back with pull.

## 2.15 PROTECTION PLATES

### A. Manufacturers:

1. Scheduled Manufacturer: Ives
2. Acceptable Manufacturers: Burns, Rockwood

B. Requirements:

1. Provide kick plates, mop plates, and armor plates minimum of 0.050 inch (1 mm) thick as scheduled. Furnish with sheet metal or wood screws, finished to match plates.
2. Sizes of plates:
  - a. Kick Plates: 10 inches (254 mm) high by 2 inches (51 mm) less width of door on single doors, 1 inch (25 mm) less width of door on pairs
  - b. Mop Plates: 4 inches (102 mm) high by 2 inches (51 mm) less width of door on single doors, 1 inch (25 mm) less width of door on pairs
  - c. Armor Plates: 36 inches (914 mm) high by 2 inches (51 mm) less width of door on single doors, 1 inch (25 mm) less width of door on pairs

## 2.16 OVERHEAD STOPS AND OVERHEAD STOP/HOLDERS

A. Manufacturers:

1. Scheduled Manufacturers: Glynn-Johnson
2. Acceptable Manufacturers: Rixson, Sargent

B. Requirements:

1. Provide heavy duty concealed mounted overhead stop or holder as specified for exterior and interior vestibule single acting doors.
2. Provide heavy duty concealed mounted overhead stop or holder as specified for double acting doors.
3. Provide heavy or medium duty and concealed or surface mounted overhead stop or holder for interior doors as specified. Provide medium duty surface mounted overhead stop for interior doors and at any door that swings more than 140 degrees before striking wall, open against equipment, casework, sidelights, and where conditions do not allow wall stop or floor stop presents tripping hazard.
4. Where overhead holders are specified provide friction type at doors without closer and positive type at doors with closer.

## 2.17 DOOR STOPS AND HOLDERS

A. Manufacturers:

1. Scheduled Manufacturer: Ives
2. Acceptable Manufacturers: Burns, Rockwood

B. Provide door stops at each door leaf:

1. Provide wall stops wherever possible. Provide convex type where mortise type locks are used and concave type where cylindrical type locks are used.

2. Where a wall stop cannot be used, provide universal floor stops for low or high rise options.
3. Where wall or floor stop cannot be used, provide medium duty surface mounted overhead stop.

## 2.18 THRESHOLDS, SEALS, DOOR SWEEPS, AUTOMATIC DOOR BOTTOMS, AND GASKETING

### A. Manufacturers:

1. Scheduled Manufacturer: Zero International
2. Acceptable Manufacturers: Pemko, Reese

### B. Requirements:

1. Provide thresholds, weatherstripping (including door sweeps, seals, astragals) and gasketing systems (including smoke, sound, and light) as specified and per architectural details. Match finish of other items.
2. Size of thresholds:
  - a. Saddle Thresholds: 1/2 inch (13 mm) high by jamb width by door width
  - b. Bumper Seal Thresholds: 1/2 inch (13 mm) high by 5 inches (127 mm) wide by door width
3. Provide door sweeps, seals, astragals, and auto door bottoms only of type where resilient or flexible seal strip is easily replaceable and readily available.

## 2.19 SILENCERS

### A. Manufacturers:

1. Scheduled Manufacturer: Ives
2. Acceptable Manufacturers: Burns, Rockwood

### B. Requirements:

1. Provide "push-in" type silencers for hollow metal or wood frames.
2. Provide one silencer per 30 inches (762 mm) of height on each single frame, and two for each pair frame.
3. Omit where gasketing is specified.

## 2.20 MAGNETIC HOLDERS

### A. Manufacturers:

1. Scheduled Manufacturer: LCN
2. Acceptable Manufacturers: Rixson, Sargent

B. Requirements:

1. Provide wall or floor mounted electromagnetic door release as specified with minimum of 25 pounds of holding force. Coordination projection of holder and armature with other hardware and wall conditions to ensure that door sits parallel to wall when fully open. Wire magnetic holders on fire-rated doors into the fire control panel for fail-safe operation.

2.21 FINSHES

A. Finish: BHMA 626/652 (US26D); except:

1. Hinges at Exterior Doors: BHMA 630 (US32D)
2. Continuous Hinges: BHMA 628 (US28)
3. Push Plates, Pulls, and Push Bars: BHMA 630 (US32D)
4. Protection Plates: BHMA 630 (US32D)
5. Overhead Stops and Holders: BHMA 630 (US32D)
6. Door Closers: Powder Coat to Match
7. Wall Stops: BHMA 630 (US32D)
8. Latch Protectors: BHMA 630 (US32D)
9. Weatherstripping: Clear Anodized Aluminum
10. Thresholds: Mill Finish Aluminum

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Prior to installation of hardware, examine doors and frames, with Installer present, for compliance with requirements for installation tolerances, labeled fire-rated door assembly construction, wall and floor construction, and other conditions affecting performance.
- B. Existing Door and Frame Compatibility: Field verify existing doors and frames receiving new hardware and existing conditions receiving new openings. Verify that new hardware is compatible with existing door and frame preparation and existing conditions.
- C. Examine roughing-in for electrical power systems to verify actual locations of wiring connections before electrified door hardware installation.
- D. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

- A. Where on-site modification of doors and frames is required:



1. Carefully remove existing door hardware and components being reused. Clean, protect, tag, and store in accordance with storage and handling requirements specified herein.
2. Field modify and prepare existing door and frame for new hardware being installed.
3. When modifications are exposed to view, use concealed fasteners, when possible.
4. Prepare hardware locations and reinstall in accordance with installation requirements for new door hardware and with:
  - a. Steel Doors and Frames: For surface applied door hardware, drill and tap doors and frames according to ANSI/SDI A250.6.
  - b. Wood Doors: DHI WDHS.5 "Recommended Hardware Reinforcement Locations for Mineral Core Wood Flush Doors."
  - c. Doors in rated assemblies: NFPA 80 for restrictions on on-site door hardware preparation.

### 3.3 INSTALLATION

- A. Mounting Heights: Mount door hardware units at heights to comply with the following, unless otherwise indicated or required to comply with governing regulations.
  1. Standard Steel Doors and Frames: ANSI/SDI A250.8.
  2. Custom Steel Doors and Frames: HMMA 831.
  3. Wood Doors: DHI WDHS.3, "Recommended Locations for Architectural Hardware for Wood Flush Doors."
- B. Install each hardware item in compliance with manufacturer's instructions and recommendations, using only fasteners provided by manufacturer.
- C. Do not install surface mounted items until finishes have been completed on substrate. Protect all installed hardware during painting.
- D. Set units level, plumb and true to line and location. Adjust and reinforce attachment substrate as necessary for proper installation and operation.
- E. Drill and countersink units that are not factory prepared for anchorage fasteners. Space fasteners and anchors according to industry standards.
- F. Install operating parts so they move freely and smoothly without binding, sticking, or excessive clearance.
- G. Hinges: Install types and in quantities indicated in door hardware schedule but not fewer than quantity recommended by manufacturer for application indicated or one hinge for every 30 inches (750 mm) of door height, whichever is more stringent, unless other equivalent means of support for door, such as spring hinges or pivots, are provided.

- H. Intermediate Offset Pivots: Where offset pivots are indicated, provide intermediate offset pivots in quantities indicated in door hardware schedule but not fewer than one intermediate offset pivot per door and one additional intermediate offset pivot for every 30 inches (750 mm) of door height greater than 90 inches (2286 mm).
- I. Lock Cylinders: Install construction cores to secure building and areas during construction period.
  - 1. Replace construction cores with permanent cores as indicated in keying section.
- J. Wiring: Coordinate with Division 26, ELECTRICAL sections for:
  - 1. Conduit, junction boxes and wire pulls.
  - 2. Connections to and from power supplies to electrified hardware.
  - 3. Connections to fire/smoke alarm system and smoke evacuation system.
  - 4. Connection of wire to door position switches and wire runs to central room or area, as directed by Architect.
  - 5. Testing and labeling wires with Architect's opening number.
- K. Key Control System: Tag keys and place them on markers and hooks in key control system cabinet, as determined by final keying schedule.
- L. Door Closers: Mount closers on room side of corridor doors, inside of exterior doors, and stair side of stairway doors from corridors. Closers shall not be visible in corridors, lobbies and other public spaces unless approved by Architect.
- M. Closer/holders: Mount closer/holders on room side of corridor doors, inside of exterior doors, and stair side of stairway doors.
- N. Power Supplies: Locate power supplies as indicated or, if not indicated, above accessible ceilings or in equipment room, or alternate location as directed by Architect.
  - 1. Configuration: Provide least number of power supplies required to adequately serve doors with electrified door hardware.
- O. Thresholds: Set thresholds in full bed of sealant complying with requirements specified in Division 07 Section "Joint Sealants."
- P. Stops: Provide floor stops for doors unless wall or other type stops are indicated in door hardware schedule. Do not mount floor stops where they may impede traffic or present tripping hazard.
- Q. Perimeter Gasketing: Apply to head and jamb, forming seal between door and frame.
- R. Meeting Stile Gasketing: Fasten to meeting stiles, forming seal when doors are closed.

- S. Door Bottoms: Apply to bottom of door, forming seal with threshold when door is closed.

### 3.4 FIELD QUALITY CONTROL

- A. Architectural Hardware Consultant: Engage qualified independent Architectural Hardware Consultant to perform inspections and to prepare inspection reports.
  1. Architectural Hardware Consultant will inspect door hardware and state in each report whether installed work complies with or deviates from requirements, including whether door hardware is properly installed and adjusted.

### 3.5 ADJUSTING

- A. Initial Adjustment: Adjust and check each operating item of door hardware and each door to ensure proper operation or function of every unit. Replace units that cannot be adjusted to operate as intended. Adjust door control devices to compensate for final operation of heating and ventilating equipment and to comply with referenced accessibility requirements.
  1. Spring Hinges: Adjust to achieve positive latching when door is allowed to close freely from an open position of 30 degrees.
  2. Electric Strikes: Adjust horizontal and vertical alignment of keeper to properly engage lock bolt.
  3. Door Closers: Adjust sweep period to comply with accessibility requirements and requirements of authorities having jurisdiction.
- B. Occupancy Adjustment: Approximately three months after date of Substantial Completion, Installer's Architectural Hardware Consultant shall examine and readjust each item of door hardware, including adjusting operating forces, as necessary to ensure function of doors, door hardware, and electrified door hardware.

### 3.6 CLEANING AND PROTECTION

- A. Clean adjacent surfaces soiled by door hardware installation.
- B. Clean operating items as necessary to restore proper function and finish.
- C. Provide final protection and maintain conditions that ensure door hardware is without damage or deterioration at time of Substantial Completion.

3.7 DEMONSTRATION

- A. Provide training for Owner's maintenance personnel to adjust, operate, and maintain door hardware and door hardware finishes. Refer to Division 01 Section "Demonstration and Training."

3.8 DOOR HARDWARE SCHEDULE

- A. Locksets, exit devices, and other hardware items are referenced in the following hardware sets for series, type and function. Refer to the above-specifications for special features, options, cylinders/keying, and other requirements.

Hardware Sets:

82216 OPT0302726 Version 2

**HARDWARE GROUP NO. 01**

*FOR USE ON DOOR #(S):*

E110	E111	E112	E113	E120A	E120B
E121	E122	E124	E125	E126	E127
E305	E306	E307	E309	E312	

*PROVIDE EACH OPENING WITH THE FOLLOWING:*

<u>QTY</u>		<u>DESCRIPTION</u>	<u>CATALOG NUMBER</u>	<u>FINISH</u>	<u>MFR</u>
1	EA	PASSAGE SET	W101S DAN	626	FAL
1			HDWE SUPPLIER/GC TO VERIFY COMPATIBILITY WITH EXISTING OPENING FOR NEW HDWE		
1			BALANCE OF HARDWARE EXISTING		

**HARDWARE GROUP NO. 02**

*FOR USE ON DOOR #(S):*

210	211A	315	E32	E39	E43
E115	E123				

*PROVIDE EACH OPENING WITH THE FOLLOWING:*

<u>QTY</u>		<u>DESCRIPTION</u>	<u>CATALOG NUMBER</u>	<u>FINISH</u>	<u>MFR</u>
1	EA	CASED OPENING	NO HARDWARE REQUIRED		

**HARDWARE GROUP NO. 03**

*FOR USE ON DOOR #(S):*

E114            E119            E311

*PROVIDE EACH OPENING WITH THE FOLLOWING:*

<b><u>QTY</u></b>		<b><u>DESCRIPTION</u></b>	<b><u>CATALOG NUMBER</u></b>	<b><u>FINISH</u></b>	<b><u>MFR</u></b>
1	EA	PRIVACY LOCK	W301S DAN	626	FAL
1			HDWE SUPPLIER/GC TO VERIFY COMPATIBILITY WITH EXISTING OPENING FOR NEW HDWE		
1			BALANCE OF HARDWARE EXISTING		

**HARDWARE GROUP NO. 04**

*FOR USE ON DOOR #(S):*

E105            E107            E109            E310            E313            E314

*PROVIDE EACH OPENING WITH THE FOLLOWING:*

<b><u>QTY</u></b>		<b><u>DESCRIPTION</u></b>	<b><u>CATALOG NUMBER</u></b>	<b><u>FINISH</u></b>	<b><u>MFR</u></b>
1	EA	ENTRY / OFFICE LOCK	W511BDC DAN	626	FAL
1	EA	SFIC CORE	C607	626	FAL
1			HDWE SUPPLIER/GC TO VERIFY COMPATIBILITY WITH EXISTING OPENING FOR NEW HDWE		
1			BALANCE OF HARDWARE EXISTING		

**HARDWARE GROUP NO. 05**

*FOR USE ON DOOR #(S):*

202                    203                    207                    208                    404                    418

*PROVIDE EACH OPENING WITH THE FOLLOWING:*

<b><u>QTY</u></b>		<b><u>DESCRIPTION</u></b>	<b><u>CATALOG NUMBER</u></b>	<b><u>FINISH</u></b>	<b><u>MFR</u></b>
3	EA	HINGE	5BB1 4.5 X 4.5 (NRP AS REQUIRED)	652	IVE
1	EA	PRIVACY LOCK	MA311 OCCUPIED/VACANT DGM	626	FAL
1	EA	SURFACE CLOSER	SC71A REG OR PA AS REQ	689	FAL
1	EA	KICK PLATE	8400 10" X 2" LDW B-CS	630	IVE
1	EA	MOP PLATE	8400 4" X 1" LDW B-CS	630	IVE
1	EA	WALL STOP	WS406/407CCV	630	IVE
1	EA	GASKETING	488SBK PSA	BK	ZER

**HARDWARE GROUP NO. 06**

*FOR USE ON DOOR #(S):*

204

*PROVIDE EACH OPENING WITH THE FOLLOWING:*

<b><u>QTY</u></b>		<b><u>DESCRIPTION</u></b>	<b><u>CATALOG NUMBER</u></b>	<b><u>FINISH</u></b>	<b><u>MFR</u></b>
3	EA	HINGE	5BB1 4.5 X 4.5 (NRP AS REQUIRED)	652	IVE
1	EA	PRIVACY LOCK	MA311 OCCUPIED/VACANT DGM	626	FAL
1	EA	OH STOP	100S	630	GLY
1	EA	SURFACE CLOSER	SC71A REG OR PA AS REQ	689	FAL
1	EA	KICK PLATE	8400 10" X 2" LDW B-CS	630	IVE
1	EA	MOP PLATE	8400 4" X 1" LDW B-CS	630	IVE
1	EA	GASKETING	488SBK PSA	BK	ZER

**HARDWARE GROUP NO. 07**

*FOR USE ON DOOR #(S):*

102	104	106	108	129	131
132	301A	301B	402	403	405
405A	407	408	409	410	

*PROVIDE EACH OPENING WITH THE FOLLOWING:*

<u>QTY</u>		<u>DESCRIPTION</u>	<u>CATALOG NUMBER</u>	<u>FINISH</u>	<u>MFR</u>
3	EA	HINGE	5BB1 4.5 X 4.5 (NRP AS REQUIRED)	652	IVE
1	EA	PASSAGE SET	T101 DAN	626	FAL
1	EA	MOP PLATE	8400 4" X 1" LDW B-CS	630	IVE
1	EA	WALL STOP	WS406/407CCV	630	IVE
1	EA	GASKETING	488SBK PSA	BK	ZER
1	EA	COAT AND HAT HOOK	582	626	IVE

**HARDWARE GROUP NO. 08**

*FOR USE ON DOOR #(S):*

101	103	116B	117	128	130
401	406	411	412	413	414
415					

*PROVIDE EACH OPENING WITH THE FOLLOWING:*

<u>QTY</u>		<u>DESCRIPTION</u>	<u>CATALOG NUMBER</u>	<u>FINISH</u>	<u>MFR</u>
3	EA	HINGE	5BB1 4.5 X 4.5 (NRP AS REQUIRED)	652	IVE
1	EA	ENTRY / OFFICE LOCK	T511BDC DAN	626	FAL
1	EA	SFIC CORE	C607	626	FAL
1	EA	MOP PLATE	8400 4" X 1" LDW B-CS	630	IVE
1	EA	WALL STOP	WS406/407CCV	630	IVE
1	EA	GASKETING	488SBK PSA	BK	ZER
1	EA	COAT AND HAT HOOK	582	626	IVE

**HARDWARE GROUP NO. 09**

*FOR USE ON DOOR #(S):*

200C	200D	200E	200F
------	------	------	------

*PROVIDE EACH OPENING WITH THE FOLLOWING:*

<u>QTY</u>		<u>DESCRIPTION</u>	<u>CATALOG NUMBER</u>	<u>FINISH</u>	<u>MFR</u>
1	EA		All Hardware by Door Supplier		

**HARDWARE GROUP NO. 10**

*FOR USE ON DOOR #(S):*

118                    205A                    206                    416

*PROVIDE EACH OPENING WITH THE FOLLOWING:*

<b><u>QTY</u></b>		<b><u>DESCRIPTION</u></b>	<b><u>CATALOG NUMBER</u></b>	<b><u>FINISH</u></b>	<b><u>MFR</u></b>
3	EA	HINGE	5BB1 4.5 X 4.5 (NRP AS REQUIRED)	652	IVE
1	EA	STOREROOM LOCK	T581BDC DAN	626	FAL
1	EA	SFIC CORE	C607	626	FAL
1	EA	SURFACE CLOSER	SC71A REG OR PA AS REQ	689	FAL
1	EA	KICK PLATE	8400 10" X 2" LDW B-CS	630	IVE
1	EA	MOP PLATE	8400 4" X 1" LDW B-CS	630	IVE
1	EA	WALL STOP	WS406/407CCV	630	IVE
1	EA	GASKETING	488SBK PSA	BK	ZER
1	EA	COAT AND HAT HOOK	582	626	IVE



**HARDWARE GROUP NO. 11**

*FOR USE ON DOOR #(S):*

133B	200A	200B	201A	201B	209A
209B	211	302A	303	315A	315B
417A					

*PROVIDE EACH OPENING WITH THE FOLLOWING:*

<u>QTY</u>		<u>DESCRIPTION</u>	<u>CATALOG NUMBER</u>	<u>FINISH</u>	<u>MFR</u>
3	EA	HINGE	5BB1 4.5 X 4.5 (NRP AS REQUIRED)	652	IVE
1	EA	POWER TRANSFER	EPT10	689	VON
1	EA	EU STOREROOM LOCK	T881BDC DAN 12/24 VDC	626	FAL
1	EA	INTERFACE BOX	JB7 AS REQUIRED		VON
1	EA	SFIC CORE	C607	626	FAL
1	EA	SURFACE CLOSER	SC71A REG OR PA AS REQ	689	FAL
1	EA	KICK PLATE	8400 10" X 2" LDW B-CS	630	IVE
1	EA	MOP PLATE	8400 4" X 1" LDW B-CS	630	IVE
1	EA	WALL STOP	WS406/407CCV	630	IVE
1	EA	GASKETING	488SBK PSA	BK	ZER
1	EA	CONTROLLER	CARD READER BY OTHERS	B	SCE
1	EA	POWER SUPPLY	PS902 900-2RS	LGR	VON
			Coordinate Power Supply Requirement with Security Provider		
1			PROVIDE FACTORY POINT TO POINT WIRING DIAGRAMS		
1			PROVIDE RISER DIAGRAMS		

*OPERATION: DOOR CLOSED AND SECURE. VALID CREDENTIAL ALLOWS ENTRY.  
 DURING FIRE EVENT OR POWER OUTAGE DOOR IS SECURE.*

**HARDWARE GROUP NO. 12**

*FOR USE ON DOOR #(S):*

E308

*PROVIDE EACH OPENING WITH THE FOLLOWING:*

<b><u>QTY</u></b>		<b><u>DESCRIPTION</u></b>	<b><u>CATALOG NUMBER</u></b>	<b><u>FINISH</u></b>	<b><u>MFR</u></b>
1	EA	CLASSROOM LOCK	T561BDC DAN	626	FAL
1	EA	SFIC CORE	C607	626	FAL
1			HDWE SUPPLIER/GC TO VERIFY COMPATIBILITY WITH EXISTING OPENING FOR NEW HDWE		
1			BALANCE OF HARDWARE EXISTING		

**HARDWARE GROUP NO. 13**

*FOR USE ON DOOR #(S):*

402A

*PROVIDE EACH OPENING WITH THE FOLLOWING:*

<b><u>QTY</u></b>		<b><u>DESCRIPTION</u></b>	<b><u>CATALOG NUMBER</u></b>	<b><u>FINISH</u></b>	<b><u>MFR</u></b>
3	EA	HINGE	5BB1 4.5 X 4.5 (NRP AS REQUIRED)	652	IVE
1	EA	CLASSROOM LOCK	T561BDC DAN	626	FAL
1	EA	SFIC CORE	C607	626	FAL
1	EA	MOP PLATE	8400 4" X 1" LDW B-CS	630	IVE
1	EA	WALL STOP	WS406/407CCV	630	IVE
1	EA	GASKETING	488SBK PSA	BK	ZER

**HARDWARE GROUP NO. 14**

*FOR USE ON DOOR #(S):*

S200

*PROVIDE EACH OPENING WITH THE FOLLOWING:*

<b><u>QTY</u></b>		<b><u>DESCRIPTION</u></b>	<b><u>CATALOG NUMBER</u></b>	<b><u>FINISH</u></b>	<b><u>MFR</u></b>
2	EA	CONT. HINGE	112XY EPT	628	IVE
2	EA	POWER TRANSFER	EPT10	689	VON
1	EA	ELEC PANIC HARDWARE	RX-MEL-25-C-C-718 24 VDC	630	FAL
1	EA	ELEC PANIC HARDWARE	RX-MEL-25-C-EO 24 VDC	630	FAL
1	EA	INTERFACE BOX	JB7 AS REQUIRED		VON
1	EA	RIM HOUSING	C953	626	FAL
1	EA	SFIC CORE	C607	626	FAL
1	EA	SFIC CONST. CORE	C607CCA	622	FAL
2	EA	90 DEG OFFSET PULL	8190EZHD 12" O	630-316	IVE
2	EA	OH STOP	100S	630	GLY
2	EA	SURFACE CLOSER	SC71A HDPA	689	FAL
2	EA	TOP RAIL DROP PLATE	SC70-18PA	689	FAL
2	EA	CUSH SHOE SUPPORT	SC70-30	689	FAL
2	EA	BLADE STOP SPACER	SC70-61	689	FAL
1	EA	GASKETING	GASKETING PROVIDED BY ALUMINUM FRAME MFGR.		B/O
2	EA	DOOR SWEEP	8198AA	AA	ZER
1	EA	THRESHOLD	65A-223	A	ZER
1	EA	CONTROLLER	CARD READER BY OTHERS	B	SCE
2	EA	DOOR CONTACT	7764	628	SCE
1	EA	POWER SUPPLY	PS902 900-2RS Coordinate Power Supply Requirement with Security Provider	LGR	VON
1			PROVIDE FACTORY POINT TO POINT WIRING DIAGRAMS		
1			PROVIDE RISER DIAGRAMS		

*OPERATION: DOOR NORMALLY CLOSED AND LOCKED. PRESENTING VALID CREDENTIAL TO READER MOMENTARILY RETRACTS PANIC DEVICE LATCH. PANIC DEVICE LATCHES ALSO CAPABLE OF BEING ELECTRONICALLY DOGGED DOWN (I.E. PUSH/PULL MODE) AS DESIGNATED BY ACCESS CONTROL SYSTEM SCHEDULE. EXIT DEVICES LATCH AND LOCK WITH ACTIVATION OF SECURITY SYSTEM. FREE EGRESS AT ALL TIMES.*

**HARDWARE GROUP NO. 15**

*FOR USE ON DOOR #(S):  
205*

*PROVIDE EACH OPENING WITH THE FOLLOWING:*

<u>QTY</u>		<u>DESCRIPTION</u>	<u>CATALOG NUMBER</u>	<u>FINISH</u>	<u>MFR</u>
3	EA	HINGE	5BB1 4.5 X 4.5 (NRP AS REQUIRED)	652	IVE
1	EA	CLASSROOM LOCK	T561BDC DAN	626	FAL
1	EA	SFIC CORE	C607	626	FAL
1	EA	SURFACE CLOSER	SC71A REG OR PA AS REQ	689	FAL
1	EA	KICK PLATE	8400 10" X 2" LDW B-CS	630	IVE
1	EA	MOP PLATE	8400 4" X 1" LDW B-CS	630	IVE
1	EA	WALL STOP	WS406/407CCV	630	IVE
1	EA	GASKETING	488SBK PSA	BK	ZER

**HARDWARE GROUP NO. 16**

*FOR USE ON DOOR #(S):  
300A*

*PROVIDE EACH OPENING WITH THE FOLLOWING:*

<u>QTY</u>		<u>DESCRIPTION</u>	<u>CATALOG NUMBER</u>	<u>FINISH</u>	<u>MFR</u>
3	EA	HINGE	5BB1HW 4.5 X 4.5 (NRP AS REQUIRED)	652	IVE
1	EA	PANIC HARDWARE	CD-25-R-L-DANE	626	FAL
2	EA	MORTISE CYLINDER	C987	626	FAL
2	EA	SFIC CORE	C607	626	FAL
1	EA	SURFACE CLOSER	SC71A REG OR PA AS REQ	689	FAL
1	EA	KICK PLATE	8400 10" X 2" LDW B-CS	630	IVE
1	EA	MOP PLATE	8400 4" X 1" LDW B-CS	630	IVE
1	EA	WALL STOP	WS406/407CCV	630	IVE
1	EA	GASKETING	488SBK PSA	BK	ZER

**HARDWARE GROUP NO. 17**

*FOR USE ON DOOR #(S):*

302B

*PROVIDE EACH OPENING WITH THE FOLLOWING:*

<u>QTY</u>		<u>DESCRIPTION</u>	<u>CATALOG NUMBER</u>	<u>FINISH</u>	<u>MFR</u>
3	EA	HINGE	5BB1 4.5 X 4.5 (NRP AS REQUIRED)	652	IVE
1	EA	PASSAGE SET	T101 DAN	626	FAL
1	EA	SURFACE CLOSER	SC71A REG OR PA AS REQ	689	FAL
1	EA	KICK PLATE	8400 10" X 2" LDW B-CS	630	IVE
1	EA	MOP PLATE	8400 4" X 1" LDW B-CS	630	IVE
1	EA	WALL STOP	WS406/407CCV	630	IVE
1	EA	GASKETING	488SBK PSA	BK	ZER
1	EA	COAT AND HAT HOOK	582	626	IVE

**HARDWARE GROUP NO. 18**

*FOR USE ON DOOR #(S):*

S300                  S400

*PROVIDE EACH OPENING WITH THE FOLLOWING:*

<u>QTY</u>		<u>DESCRIPTION</u>	<u>CATALOG NUMBER</u>	<u>FINISH</u>	<u>MFR</u>
1	EA	CONT. HINGE	112XY	628	IVE
1	EA	PANIC HARDWARE	CD-25-R-NL-OP	630	FAL
1	EA	RIM HOUSING	C953	626	FAL
1	EA	MORTISE CYLINDER	C987	626	FAL
2	EA	SFIC CORE	C607	626	FAL
1	EA	SFIC CONST. CORE	C607CCA	622	FAL
1	EA	90 DEG OFFSET PULL	8190EZHD 12" O	630-316	IVE
1	EA	OH STOP	100S	630	GLY
1	EA	SURFACE CLOSER	SC71A HDPA	689	FAL
1	EA	TOP RAIL DROP PLATE	SC70-18PA	689	FAL
1	EA	CUSH SHOE SUPPORT	SC70-30	689	FAL
1	EA	BLADE STOP SPACER	SC70-61	689	FAL
1	EA	GASKETING	GASKETING PROVIDED BY ALUMINUM FRAME MFR.		B/O
1	EA	DOOR SWEEP	8198AA	AA	ZER
1	EA	THRESHOLD	65A-223	A	ZER
1	EA	DOOR CONTACT	7764	628	SCE

**HARDWARE GROUP NO. 19**

*FOR USE ON DOOR #(S):*

S100

*PROVIDE EACH OPENING WITH THE FOLLOWING:*

<u>QTY</u>		<u>DESCRIPTION</u>	<u>CATALOG NUMBER</u>	<u>FINISH</u>	<u>MF</u> <u>R</u>
2	EA	CONT. HINGE	112XY	628	IVE
1	EA	PANIC HARDWARE	CD-25-C-C-718	630	FAL
1	EA	PANIC HARDWARE	CD-25-C-EO	630	FAL
1	EA	RIM HOUSING	C953	626	FAL
2	EA	MORTISE CYLINDER	C987	626	FAL
3	EA	SFIC CORE	C607	626	FAL
1	EA	SFIC CONST. CORE	C607CCA	622	FAL
2	EA	90 DEG OFFSET PULL	8190EZHD 12" O	630-316	IVE
2	EA	OH STOP	100S	630	GL Y
2	EA	SURFACE CLOSER	SC71A HDPA	689	FAL
2	EA	TOP RAIL DROP PLATE	SC70-18PA	689	FAL
2	EA	CUSH SHOE SUPPORT	SC70-30	689	FAL
2	EA	BLADE STOP SPACER	SC70-61	689	FAL
1	EA	GASKETING	GASKETING PROVIDED BY ALUMINUM FRAME MFGR.		B/O
2	EA	DOOR SWEEP	8198AA	AA	ZER
1	EA	THRESHOLD	65A-223	A	ZER
2	EA	DOOR CONTACT	7764	628	SCE
1	EA	POWER SUPPLY	PS902 900-2RS Coordinate Power Supply Requirement with Security Provider	LGR	VO N

**HARDWARE GROUP NO. 20**

*FOR USE ON DOOR #(S):*

E116A      E133A      E209B      E210      E304      E315B  
 E417B

*PROVIDE EACH OPENING WITH THE FOLLOWING:*

<u>QTY</u>	<u>DESCRIPTION</u>	<u>CATALOG NUMBER</u>	<u>FINISH</u>	<u>MF</u> <u>R</u>
1	EXISTING DOOR, FRAME AND HARDWARE			

**HARDWARE GROUP NO. 21**

*FOR USE ON DOOR #(S):*

E2	E3	E4	E5	E6	E7
E8	E9	E11	E13	E14	E15
E16	E17	E18	E20	E21	E22
E23	E24	E25	E26	E27	E28
E29	E30	E31	E37	E47	


*PROVIDE EACH OPENING WITH THE FOLLOWING:*

<u>QTY</u>	<u>DESCRIPTION</u>	<u>CATALOG NUMBER</u>	<u>FINISH</u>	<u>MFR</u>
1	EA NOTE	NO WORK REQUIRED DOORWAY TO BE REMOVED		


End of Section

This page is intentionally left blank.




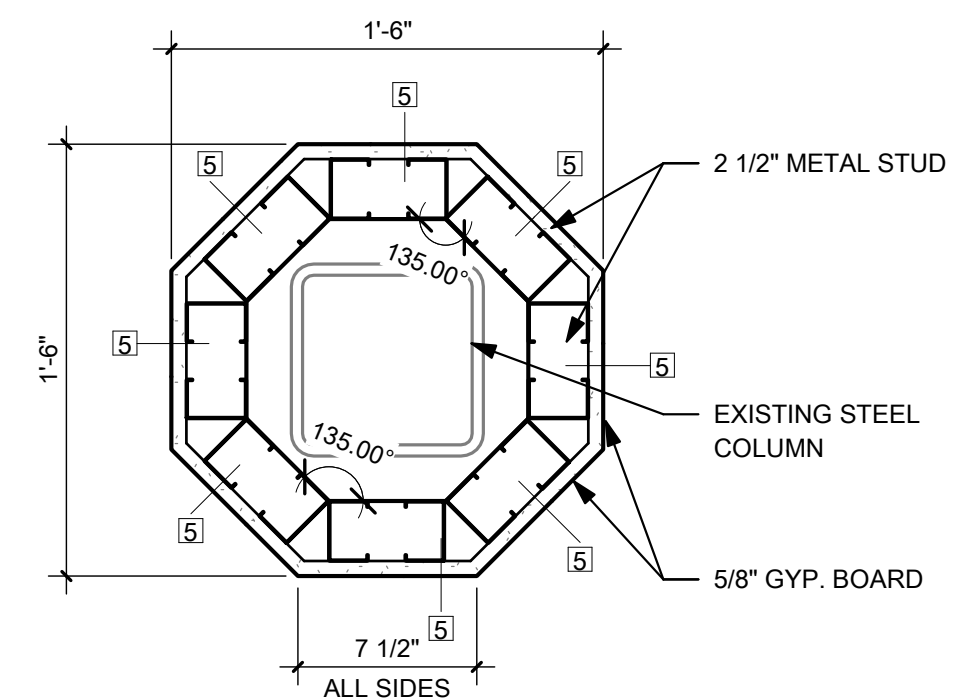

**2 COLUMN WRAP DETAIL**  
1 1/2" = 1'-0"

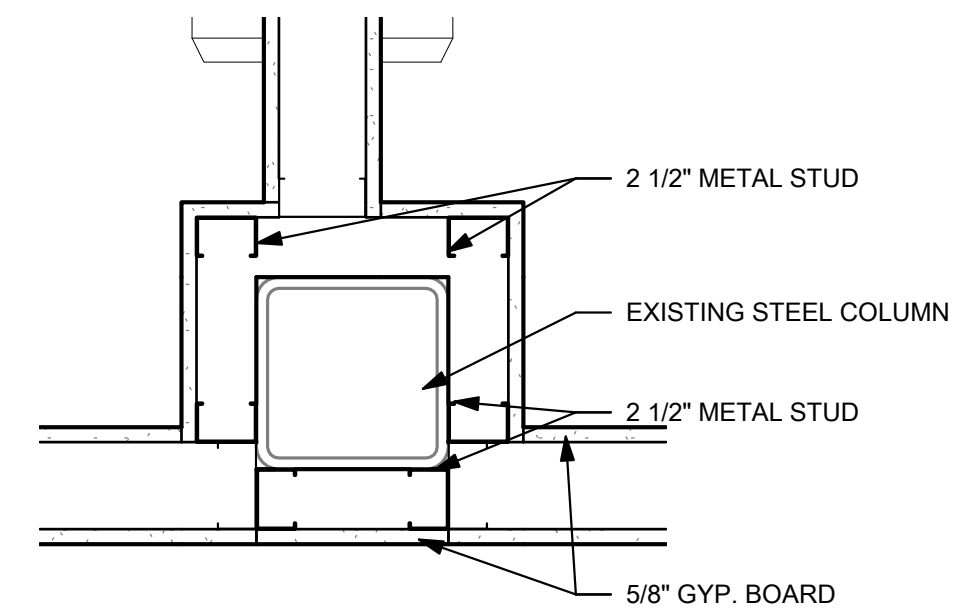


**3 COLUMN WRAP DETAIL**  
1 1/2" = 1'-0"

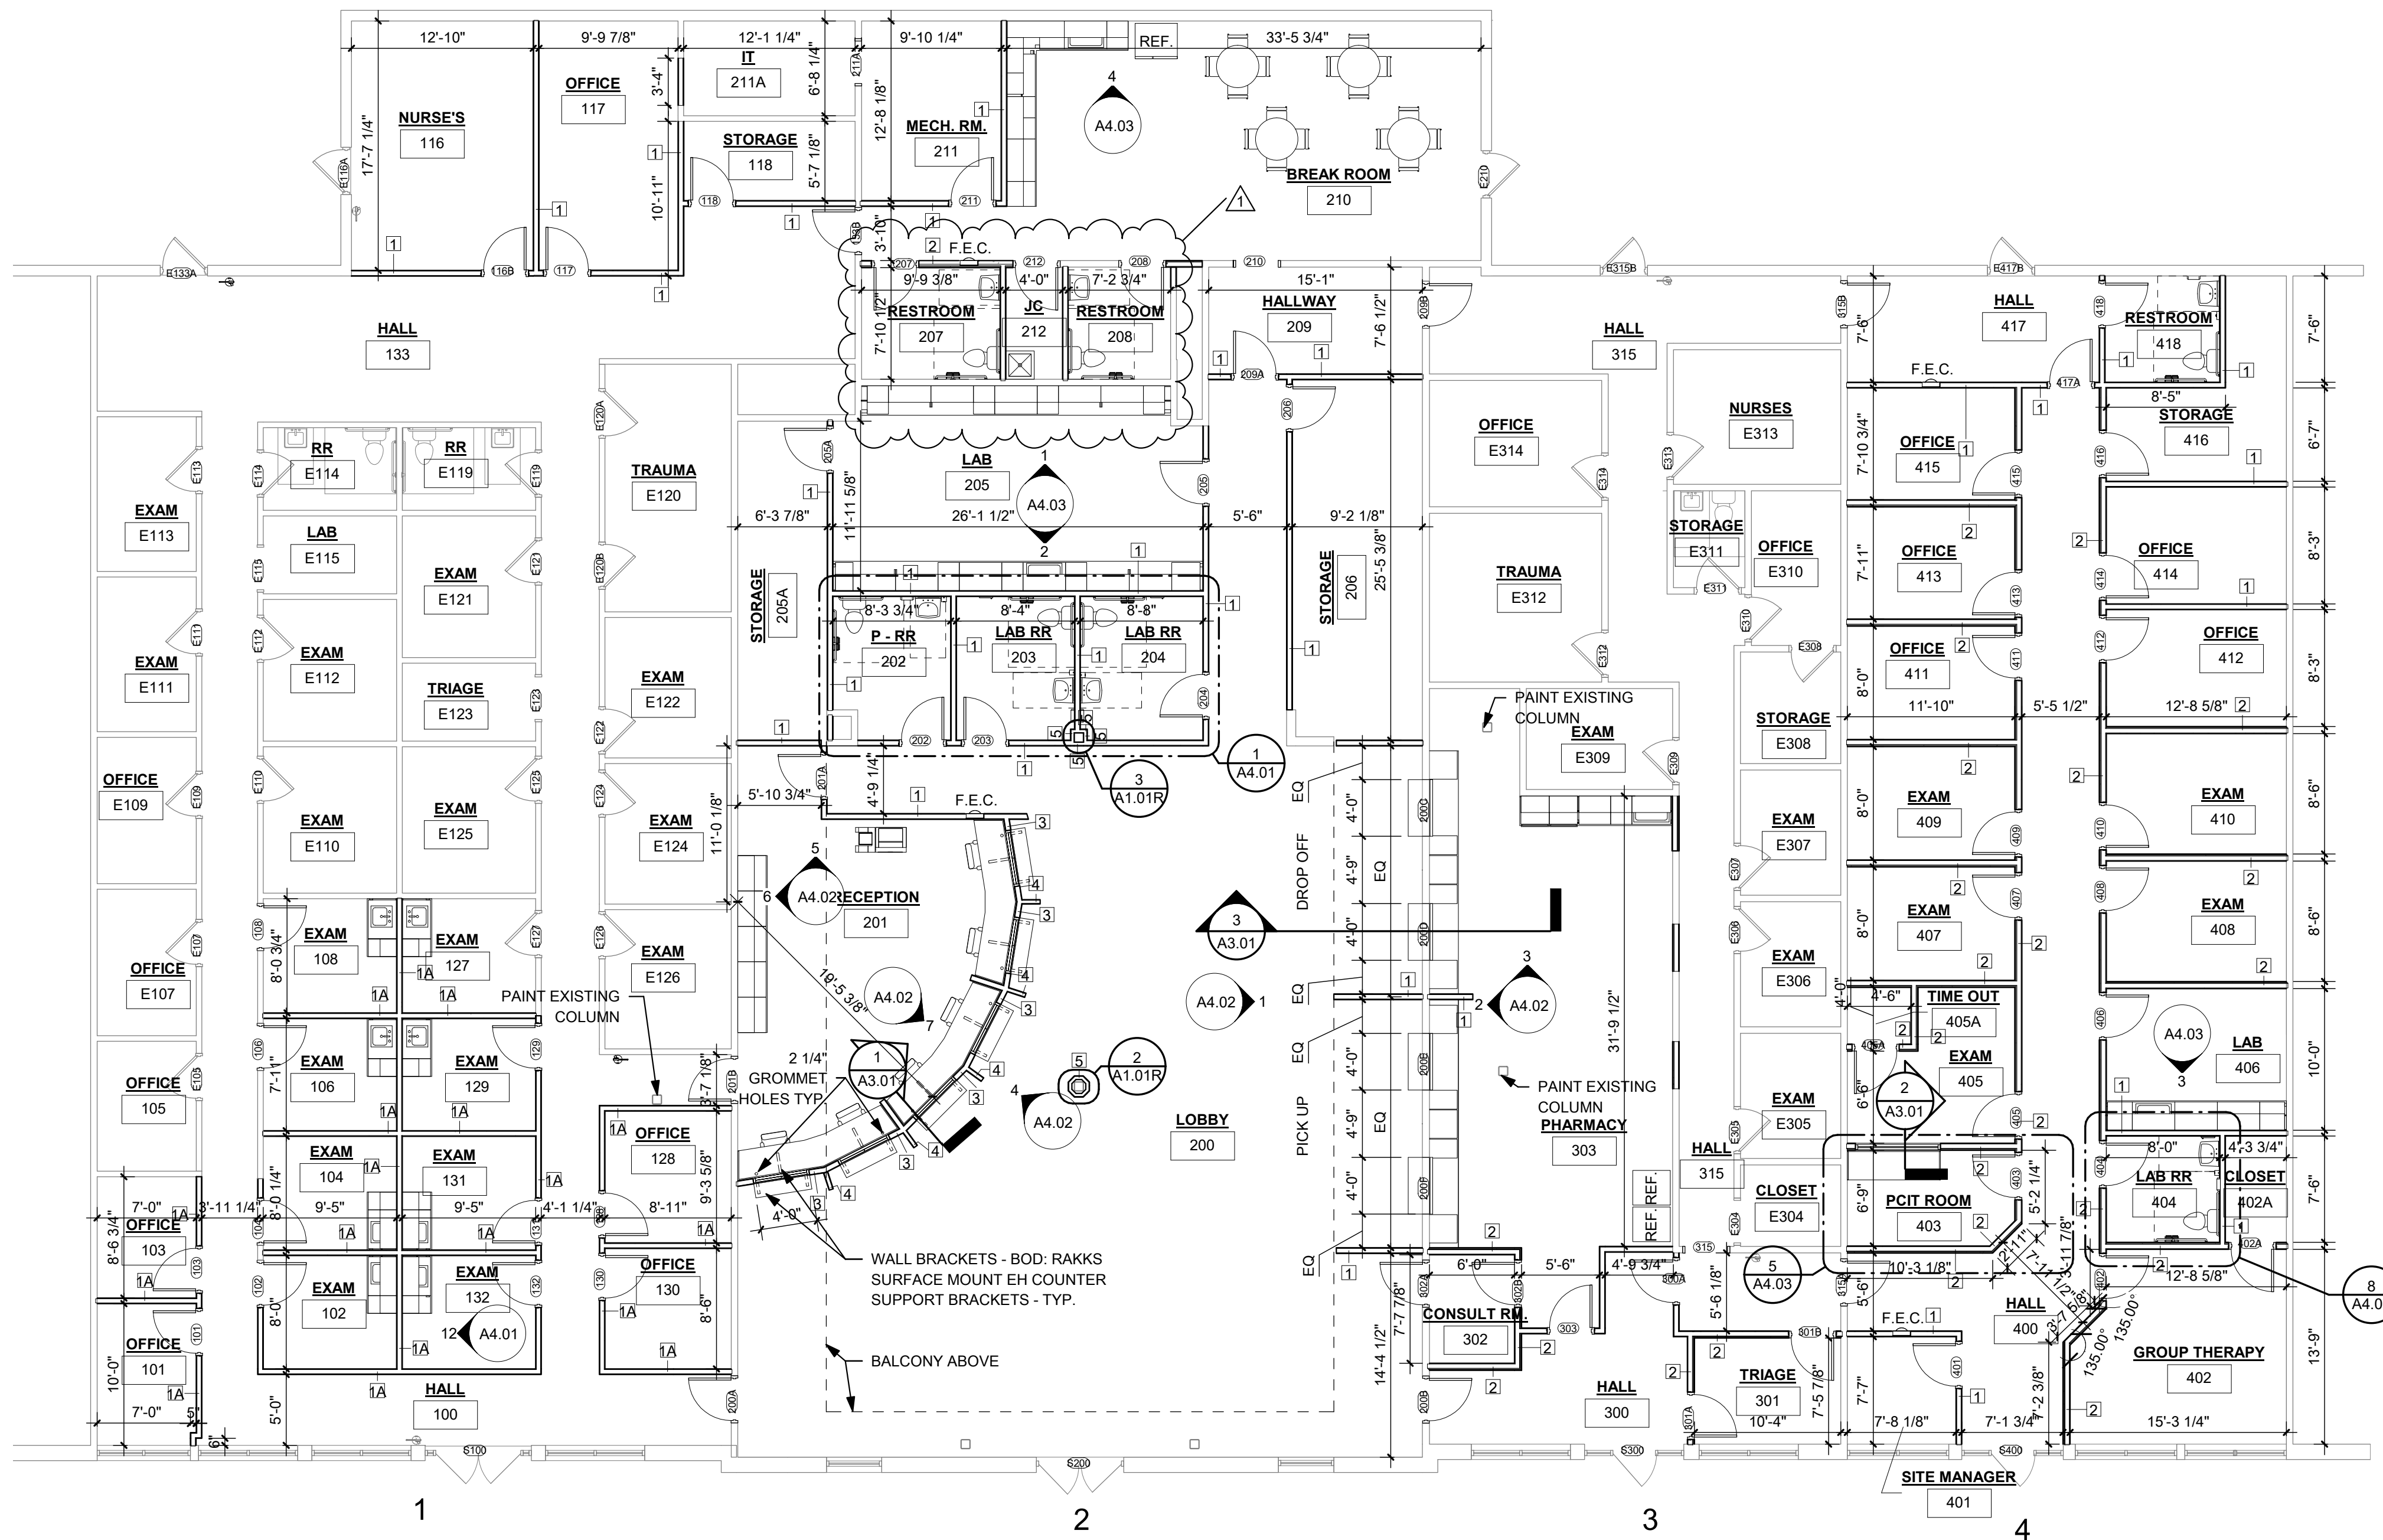

**1 FIRST FLOOR PLAN**  
1/8" = 1'-0"

NOTE: CONTRACTOR RESPONSIBLE FOR VERIFYING ALL DIMENSIONS, EXISTING WALL THICKNESS, AND COLUMN LOCATIONS IN THE FIELD. REPORT ANY DISCREPANCIES TO ARCHITECT.



**NEW CONSTRUCTION PLAN LEGEND**

- PROJECT BOUNDARY
- EXISTING TO REMAIN
- NEW CONSTRUCTION
- NEW PARTITION WALL TYPE - SEE A5.01

**GENERAL NOTES:**

- THE SCOPE OF THE WORK IS GENERALLY LIMITED TO THE AREAS SHOWN ON THESE PLANS. WORK NECESSARY TO RUN ELECTRICAL SERVICE TO EXISTING PANELS OR EXTEND OR REROUTE OTHER UTILITY LINES IS ALSO INCLUDED
- VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS PRIOR TO COMMENCEMENT OF ANY ON SITE ACTIVITIES.
- DIMENSIONS SHOWN ON THESE PLANS ARE TYPICALLY FROM FACE OF FINISHED WALL TO FACE OF FINISHED WALL UNLESS NOTED OTHERWISE
- PATCH EXISTING WALLS WHERE DEMOLITION OR OTHER CUTTING OF WALL SURFACES IS REQ'D TO MATCH EXISTING CONSTRUCTION AND FINISHES, INCLUDING INSULATION MATLS.
- TYPICAL NEW WALLS SHALL BE 6" ABOVE FINISHED CEILING HEIGHT. WITH THE EXCEPTION OF PARTITION WALL TYPE #2. SEE A5.01 FOR PARTITION WALL TYPE DETAILS. VERIFY CEILING HEIGHTS ON ROOM FINISH SCHEDULE. CONTRACTOR SHALL MATCH EXISTING CONSTRUCTION (STUD SIZE AND GWB. THICKNESS) WHERE APPROPRIATE TO FILL IN GAPS IN WALL OR EXTEND EXISTING WALLS.
- CONTRACTOR SHALL SCHEDULE NOISY, NOXIOUS, OR DISRUPTIVE ACTIVITIES OUTSIDE OF BUSINESS HOURS.
- ALL NEW PARTITIONS TO BE TYPE (1) UNLESS NOTED OTHERWISE. VERIFY EXISTING WALL THICKNESS TO DETERMINE INFILL TYPE.
- INSTALL WOOD BLOCKING IN NEW WALLS TO RECEIVE WALL-MOUNTED ITEMS. WOOD BLOCKING SHALL BE FIRE RETARDANT TREATED
- PREPARE ALL NEW AND EXISTING WALL SURFACES TO RECEIVE SCHEDULED FINISH.
- FINISH FLOOR MAT'L TRANSITIONS SHALL OCCUR AT CENTERLINE OF DOOR.
- THE OTHER AREAS OF THE BUILDING WILL REMAIN IN OPERATION FOR THE DURATION OF THE CONSTRUCTION CONTRACT. COOPERATION AND CONSIDERATION BY THE CONTRACTOR AND WORKMEN ON SITE WILL BE REQ'D. THE CONTRACTOR SHALL SCHEDULE AND COORDINATE WORK ACTIVITIES WITH THE OWNER.

NO.	BY	DATE	DESCRIPTION
1	MLB	11-22-2022	ADD ROOM - JC 212

**CCW FLATWOODS  
RENOVATIONS & FITOUTS**  
COMMUNITY CARE OF WEST VIRGINIA  
250 SKIDMORE LANE SUTTON, WV 26601  
NOVEMBER 4, 2022  
CONSTRUCTION DOCUMENTS

DRAWN: CFC DATE: 11/04/2022  
CHECKED: TTG DATE: 11/04/2022  
APPROVED: TTG DATE: 11/04/2022

PROJECT No. 060-10268

FLOOR PLAN


SHEET No.

**A1.01R**




**DOOR FRAME & HARDWARE SCHEDULE**


#	DOOR						FRAME				FIRE RATING	HARDWARE SET	REMARKS
	TYPE	WIDTH	HEIGHT	THICKNESS	MATERIAL	FINISH	FRAME TYPE	FRAME DEPTH	FRAME MATERIAL	FRAME FINISH			
101	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	2	5 3/4"	WOOD	STAIN		08	
102	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	2	5 3/4"	WOOD	STAIN		07	
103	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	2	5 3/4"	WOOD	STAIN		08	
104	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	2	5 3/4"	WOOD	STAIN		07	
106	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	2	5 3/4"	WOOD	STAIN		07	
108	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	2	5 3/4"	WOOD	STAIN		07	
116B	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	2	5 3/4"	WOOD	STAIN		08	
117	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	2	5 3/4"	WOOD	STAIN		08	
118	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT	60 MIN.	10	
128	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	2	5 3/4"	WOOD	STAIN		08	
129	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	2	5 3/4"	WOOD	STAIN		07	
130	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	2	5 3/4"	WOOD	STAIN		08	
131	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	2	5 3/4"	WOOD	STAIN		07	
132	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	2	5 3/4"	WOOD	STAIN		07	
133B	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		11	ELECTRIC & DATA REQUIRED AT DOOR
200A	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		11	ELECTRIC & DATA REQUIRED AT DOOR
200B	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		11	ELECTRIC & DATA REQUIRED AT DOOR
200C	RD	4'-0"	4'-0"	1/2"	WOOD							09	
200D	RD	4'-0"	4'-0"	1/2"	WOOD							09	
200F	RD	4'-0"	4'-0"	1/2"	WOOD							09	
201A	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		11	ELECTRIC & DATA REQUIRED AT DOOR
201B	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		11	ELECTRIC & DATA REQUIRED AT DOOR
202	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		05	
203	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		05	
204	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		05	
205	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		15	
205A	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT	60 MIN.	10	
206	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT	60 MIN.	10	
207	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		05	
208	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		05	
209A	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		11	ELECTRIC & DATA REQUIRED AT DOOR
209B	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		11	ELECTRIC & DATA REQUIRED AT DOOR
210	CO	3'-0"	7'-0"	0"			1	5 3/4"	H.M.	PAINT		02	
211	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT	60 MIN.	11	ELECTRIC & DATA REQUIRED AT DOOR
211A	CO	3'-0"	7'-0"	0"			1	5 3/4"	H.M.	PAINT		02	
212	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		10	
300A	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	2	5 3/4"	WOOD	STAIN		16	
301A	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	2	5 3/4"	WOOD	STAIN		07	
301B	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	2	5 3/4"	WOOD	STAIN		07	
302A	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		11	ELECTRIC & DATA REQUIRED AT DOOR
302B	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		17	
303	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	2	5 3/4"	WOOD	STAIN		11	ELECTRIC & DATA REQUIRED AT DOOR
315	CO	3'-0"	7'-0"	0"			1	5 3/4"	H.M.	PAINT		02	
315A	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		11	ELECTRIC & DATA REQUIRED AT DOOR
315B	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		11	ELECTRIC & DATA REQUIRED AT DOOR
401	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		08	
402	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		07	
402A	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		13	
403	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		07	
404	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		05	
405	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		07	
405A	N	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		07	
406	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		15	
407	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		07	
408	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		07	
409	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		07	
410	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		07	
411	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		08	
412	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		08	
413	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		08	
414	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		08	
415	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		08	
416	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT	60 MIN.	10	
417A	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		11	ELECTRIC & DATA REQUIRED AT DOOR
418	F	3'-0"	7'-0"	1 3/4"	WOOD	STAIN	1	5 3/4"	H.M.	PAINT		05	
S100	DFG	6'-0"	6'-11"	1 3/4"	ALUM.			4 1/2"	ALUM.			19	
S200	DFG	5'-10"	6'-11"	1 3/4"	ALUM.			4 1/2"	ALUM.			14	EXISTING TO REMAIN - ELECTRIC & DATA AT DOOR
S300	FG	3'-0"	6'-11"	1 3/4"	ALUM.			4 1/2"	ALUM.			18	
S400	FG	3'-0"	6'-11"	1 3/4"	ALUM.			4 1/2"	ALUM.			18	

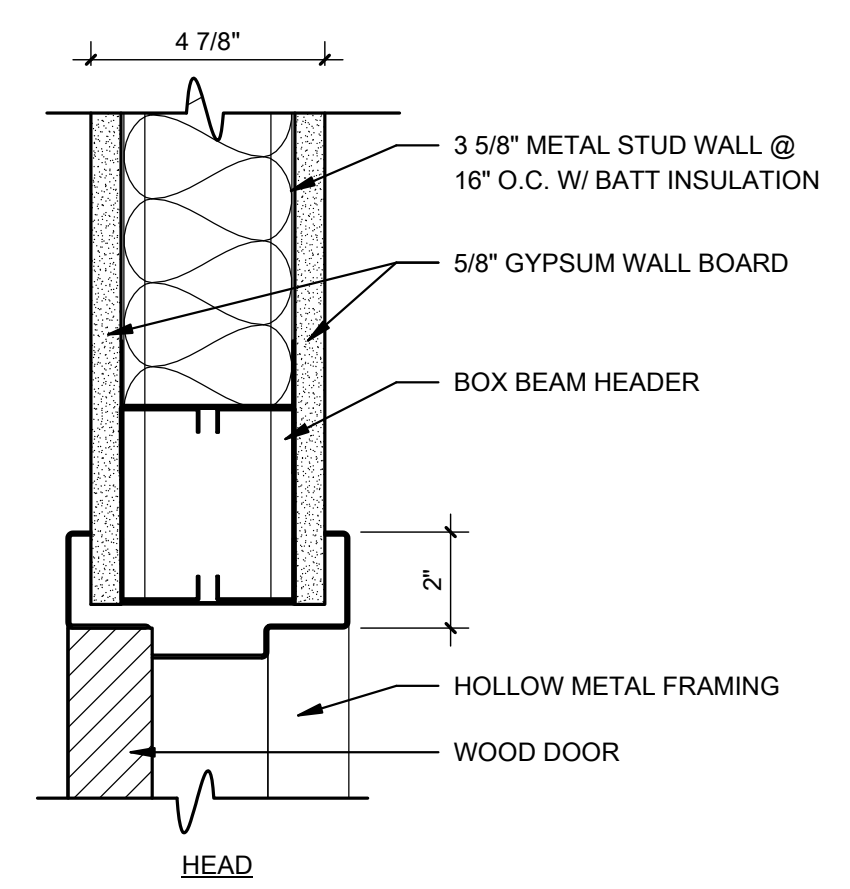


1 DOOR DETAIL - INT. METAL FRAMING WALL TYPE 1  
3" = 1'-0"

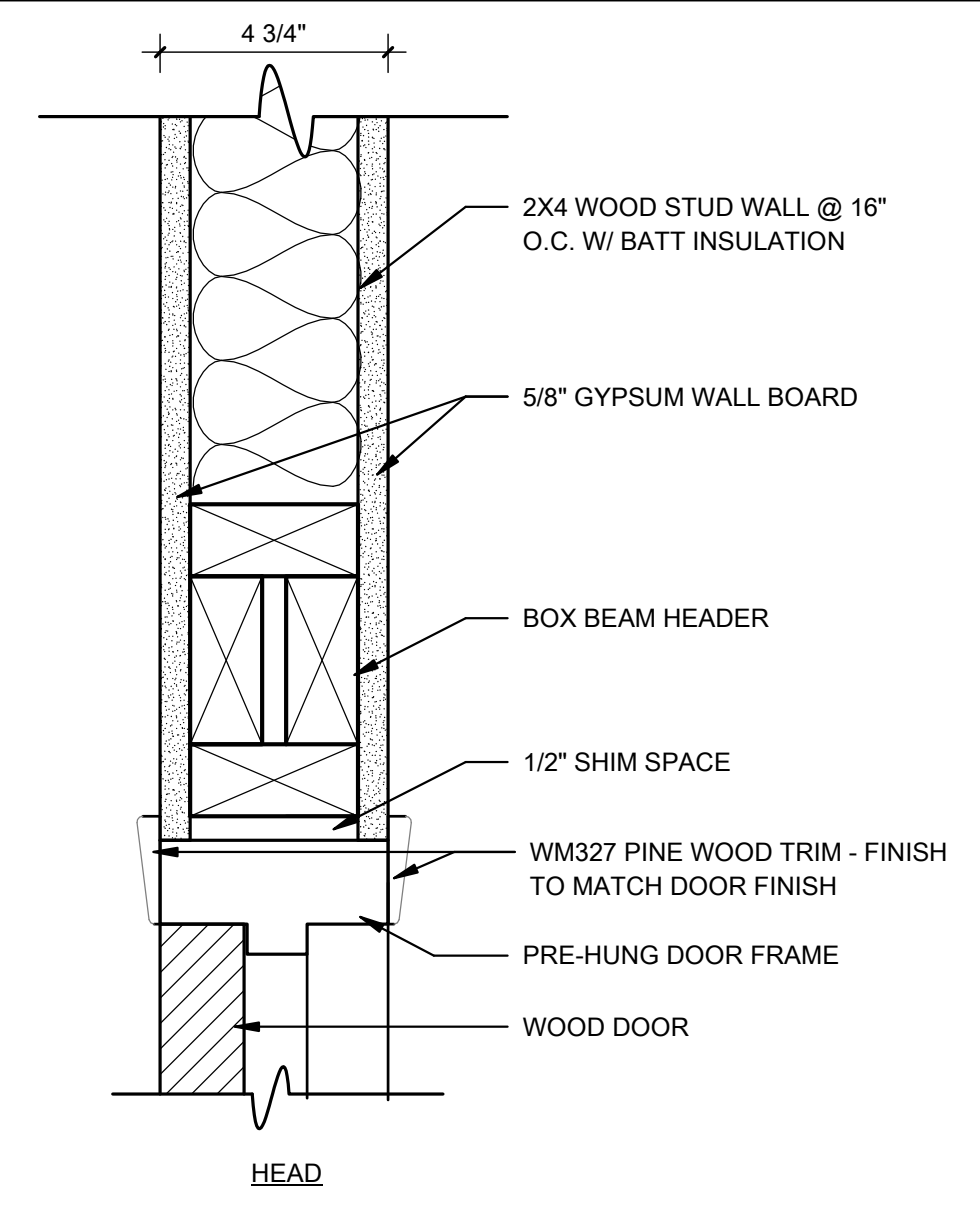

2 DOOR DETAIL - INT. WOOD DOOR AND TRIM  
3" = 1'-0"

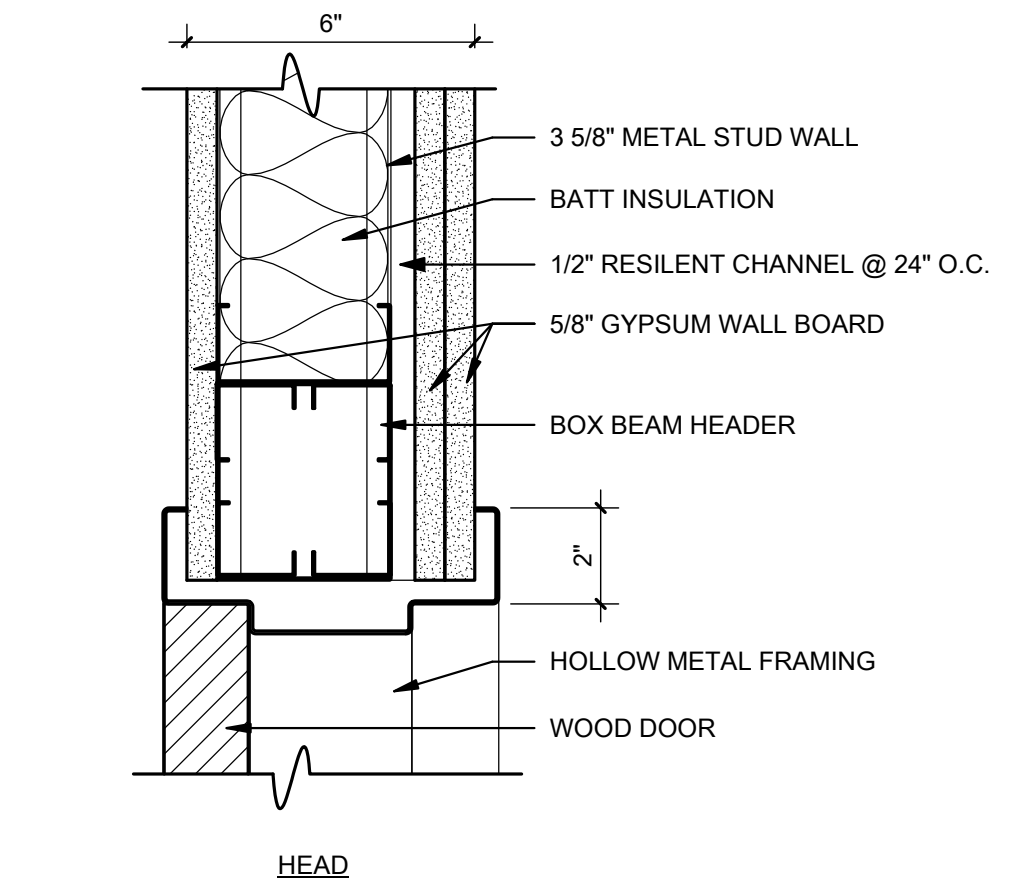

3 DOOR DETAIL - INT. METAL FRAMING WALL TYPE 2  
3" = 1'-0"

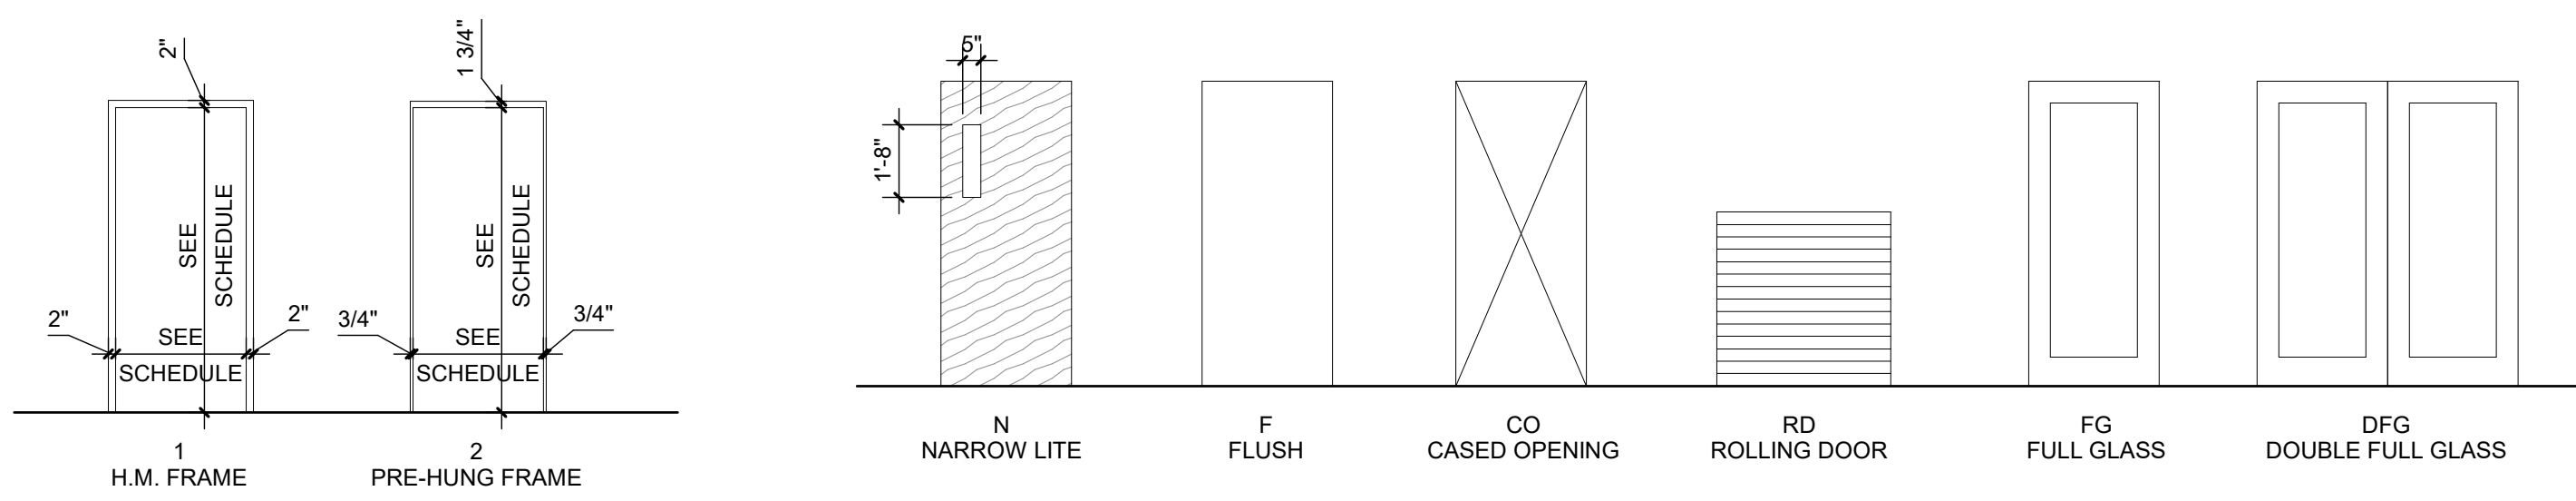

FRAME TYPE LEGEND  
1/4" = 1'-0"

DOOR TYPE LEGEND  
1/4" = 1'-0"

**THRASHER**  
600 WHITE OAKS BLVD.  
P.O. BOX 940  
BRIDGEPORT, WV 26330  
P (304) 624-4108  
F (304) 624-7831  
www.thrashergroup.com

THE INFORMATION CONTAINED HEREIN IS THE SOLE PROPERTY OF THE THRASHER GROUP, INC. REPRODUCTION OF THESE DOCUMENTS IN WHOLE OR IN PART FOR ANY REASON WITHOUT PRIOR WRITTEN PERMISSION IS STRICTLY PROHIBITED. COPYRIGHT © 2022 THE THRASHER GROUP, INC.

NO.	BY	DATE	DESCRIPTION
2	MLB	11-22-2022	DOOR HARDWARE

**CCW FLATWOODS RENOVATIONS & FITOUTS**  
COMMUNITY CARE OF WEST VIRGINIA  
250 SKIDMORE LANE SUTTON, WV 26601  
NOVEMBER 4, 2022  
CONSTRUCTION DOCUMENTS

DRAWN: CFC DATE: 11/04/2022  
CHECKED: TTG DATE: 11/04/2022  
APPROVED: TTG DATE: 11/04/2022

PROJECT No. 060-10268

SCHEDULES & DIAGRAMS

SHEET No.

**A6.01R**


LAYOUT TAB: SCHEDULES & DIAGRAMS  
CAD FILE: R:\060060-10268-001-FLATWOODS CENTER-COMMUNITY CARE OF WV\Drawings\REVIT\20221117\_FLATWOODS Community Care\_V21\_BIDDING MODEL.rvt  
PLOT DATE/TIME: 11/22/2022 9:48:49 AM  
USER: CFC

**GENERAL ROOM FINISH NOTES**

- A. FLOOR FINISH CONTINUES UNDER ALL OPEN COUNTERS, CASEWORK, FURNITURE, FIXTURES AND EQUIPMENT. FLOOR PATTERNS ON THE DRAWINGS ARE SHOWN FOR VISUAL CLARITY ONLY.
- B. WHERE FLOOR MATERIAL CHANGES IN DOORWAYS, PLACE TRANSITION UNDERNEATH DOOR LEAF.
- C. REFER TO REFLECTED CEILING PLAN FOR CEILING TILE SPECIFICATION, LOCATION OF GWB SOFFITS, ETC.

**KEYED FINISH NOTES**

- 1 ARTIFICIAL MAPLE TREES BY OWNER AND INSTALLED BY CONTRACTOR. EACH WILL BE 13'-0" TALL WITH A 10'-0" CANOPY SPREAD IN A WEIGHTED POT.
- 2 PLAM-1 COUNTERTOP AND WALL CABINETS.  
PLAM-2 BASE CABINETS
- 3 PLAM-3 COUNTERTOP AND WALL CABINETS  
PLAM-4 BASE CABINETS
- 4 PLAM-3 COUNTERTOP AND WALL CABINETS  
PLAM-2 BASE CABINETS
- 5 PLAM-4 COUNTER

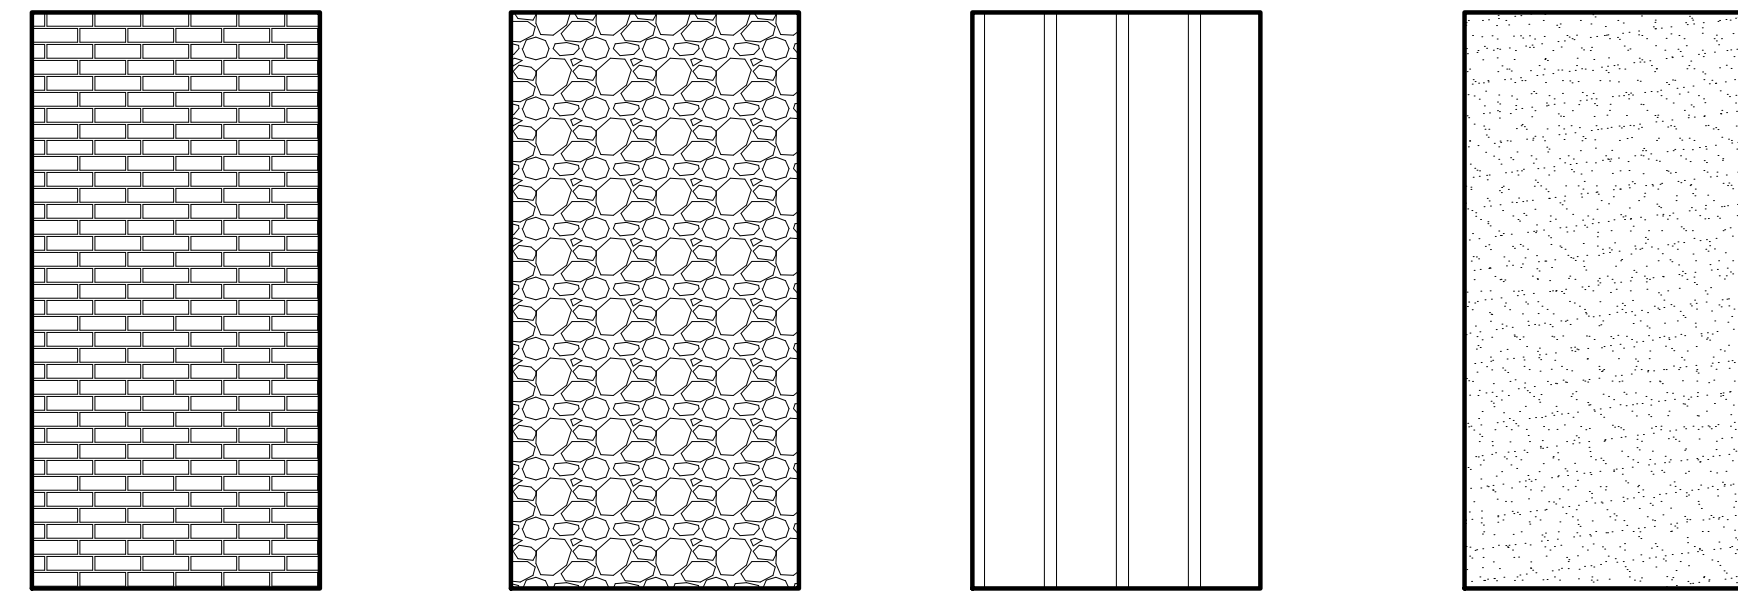

MDF-3 AND MDF-9  
RUNNING BOND BRICK PATTERN, STANDARD SIZE: 3-5/8" X 8" "BRICK" AND 3/8"W X 1/4"D ROUTED "MORTAR JOINT"


MDF-2  
STONE WALL PATTERN WITH VARYING SIZES OF "STONE" AND 5/16"W X 1/4"D ROUTED "MORTAR JOINTS"

MDF-7 AND MDF-8  
BOARD AND BATTEN PATTERN, STANDARD SIZE: ROUTED 10"W X 1/4"D "BOARD," 2" WIDE "BATTEN"

MDF-1, MDF-4, MDF-5, AND MDF-6  
STUCCO PATTERN, ROUTED TEXTURED PATTERN EVENLY THROUGHOUT


**3 ARCHITECTURAL WALL PANEL TYPES**

SCALE: 3/8" = 1'-0"

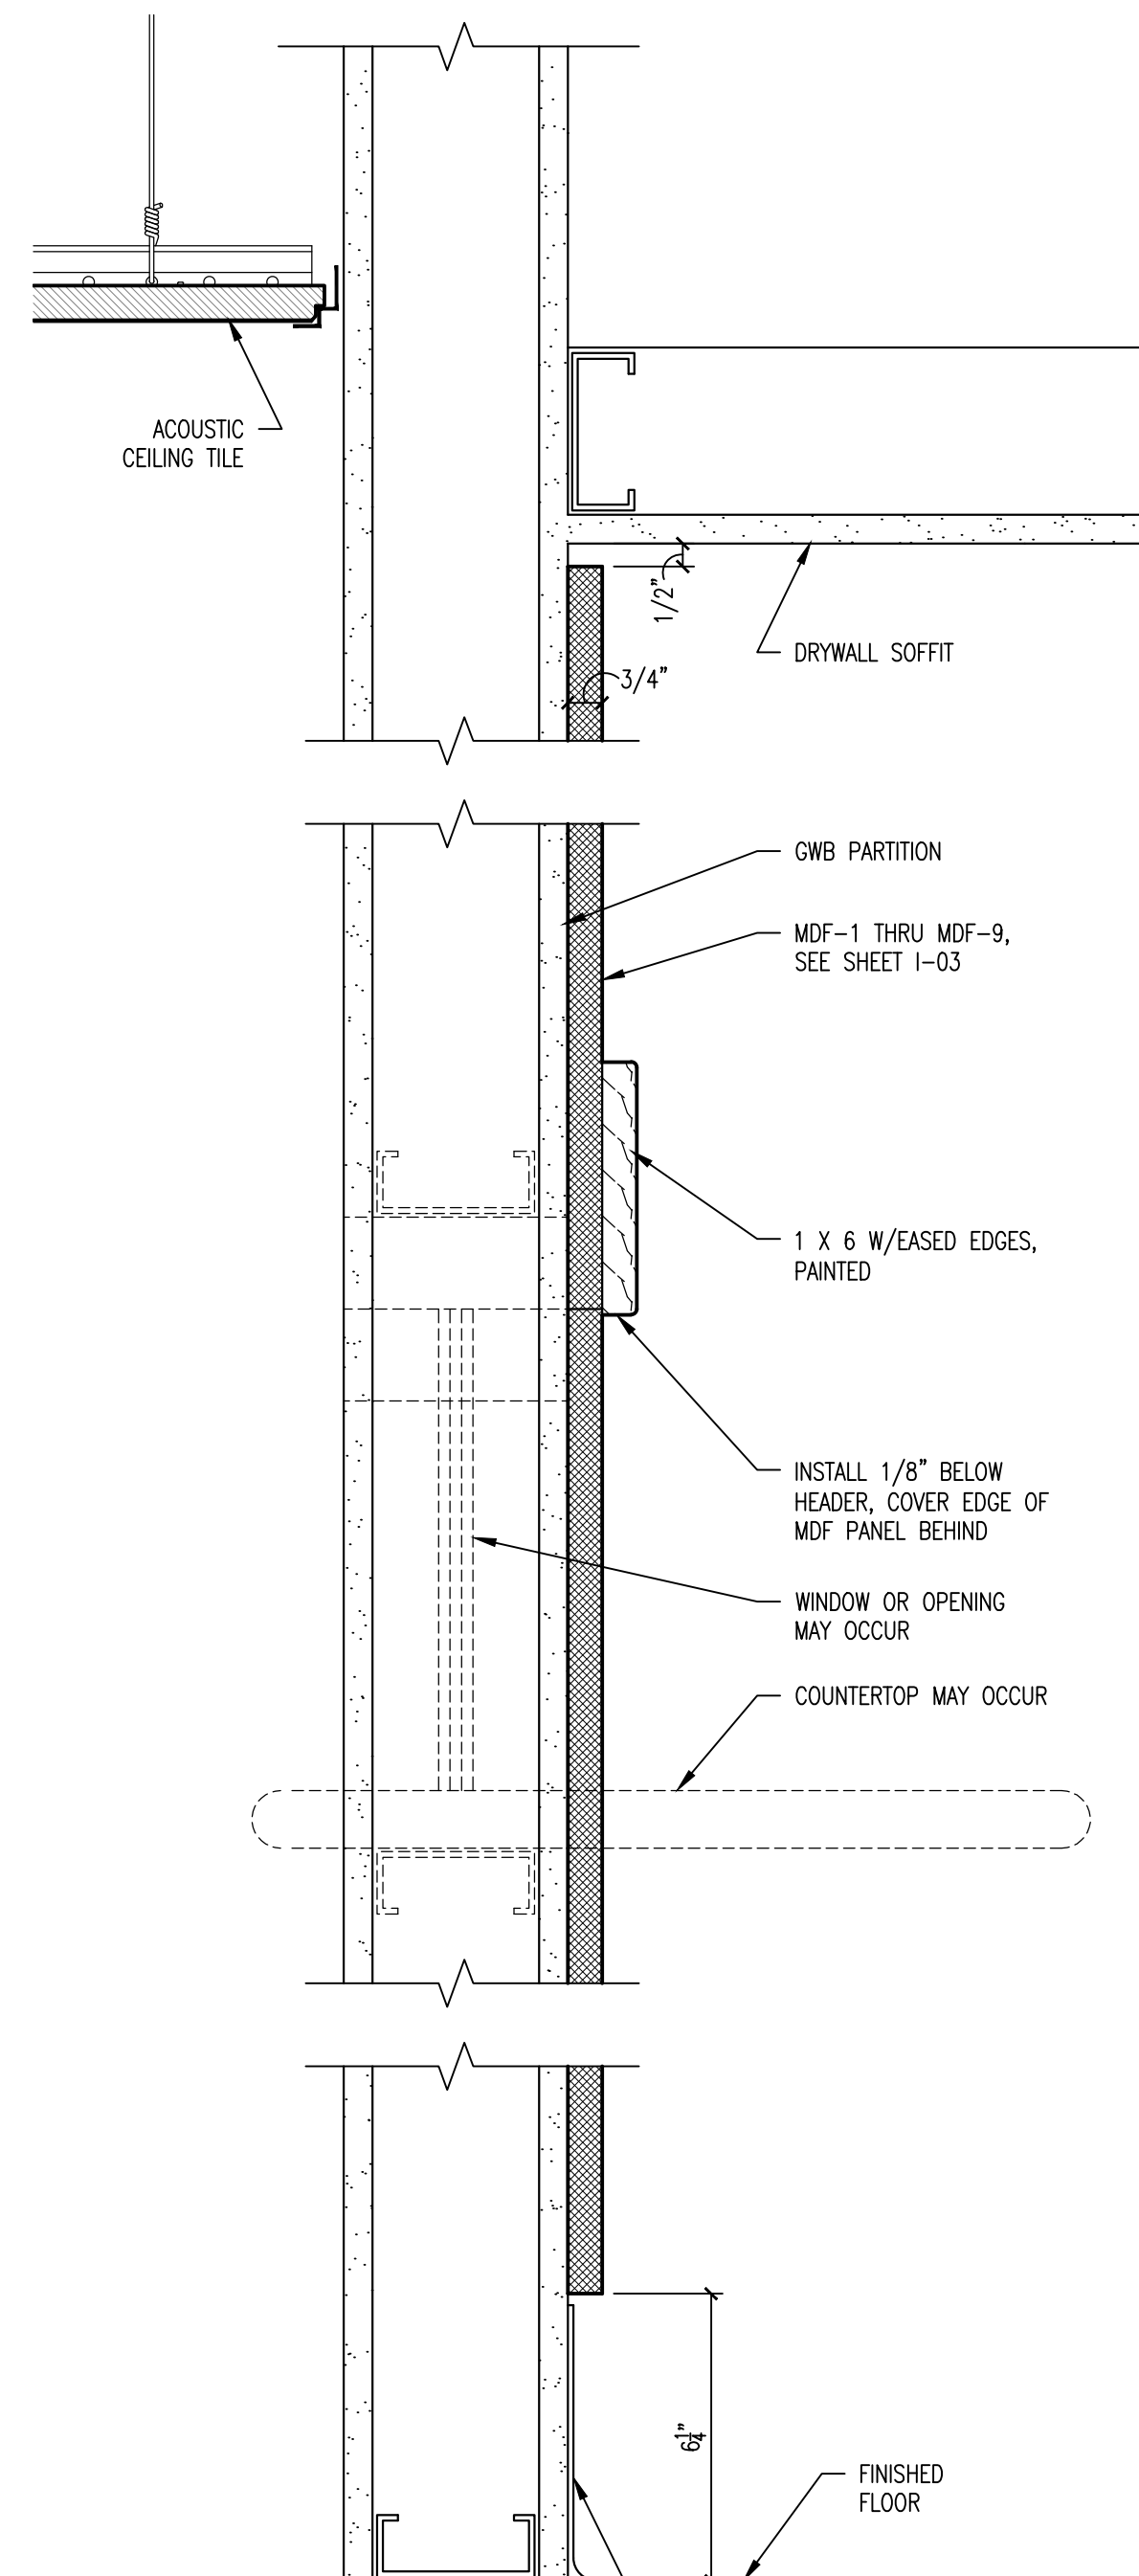

**2 TYPICAL SECTION**

SCALE: 3/8" = 1'-0"

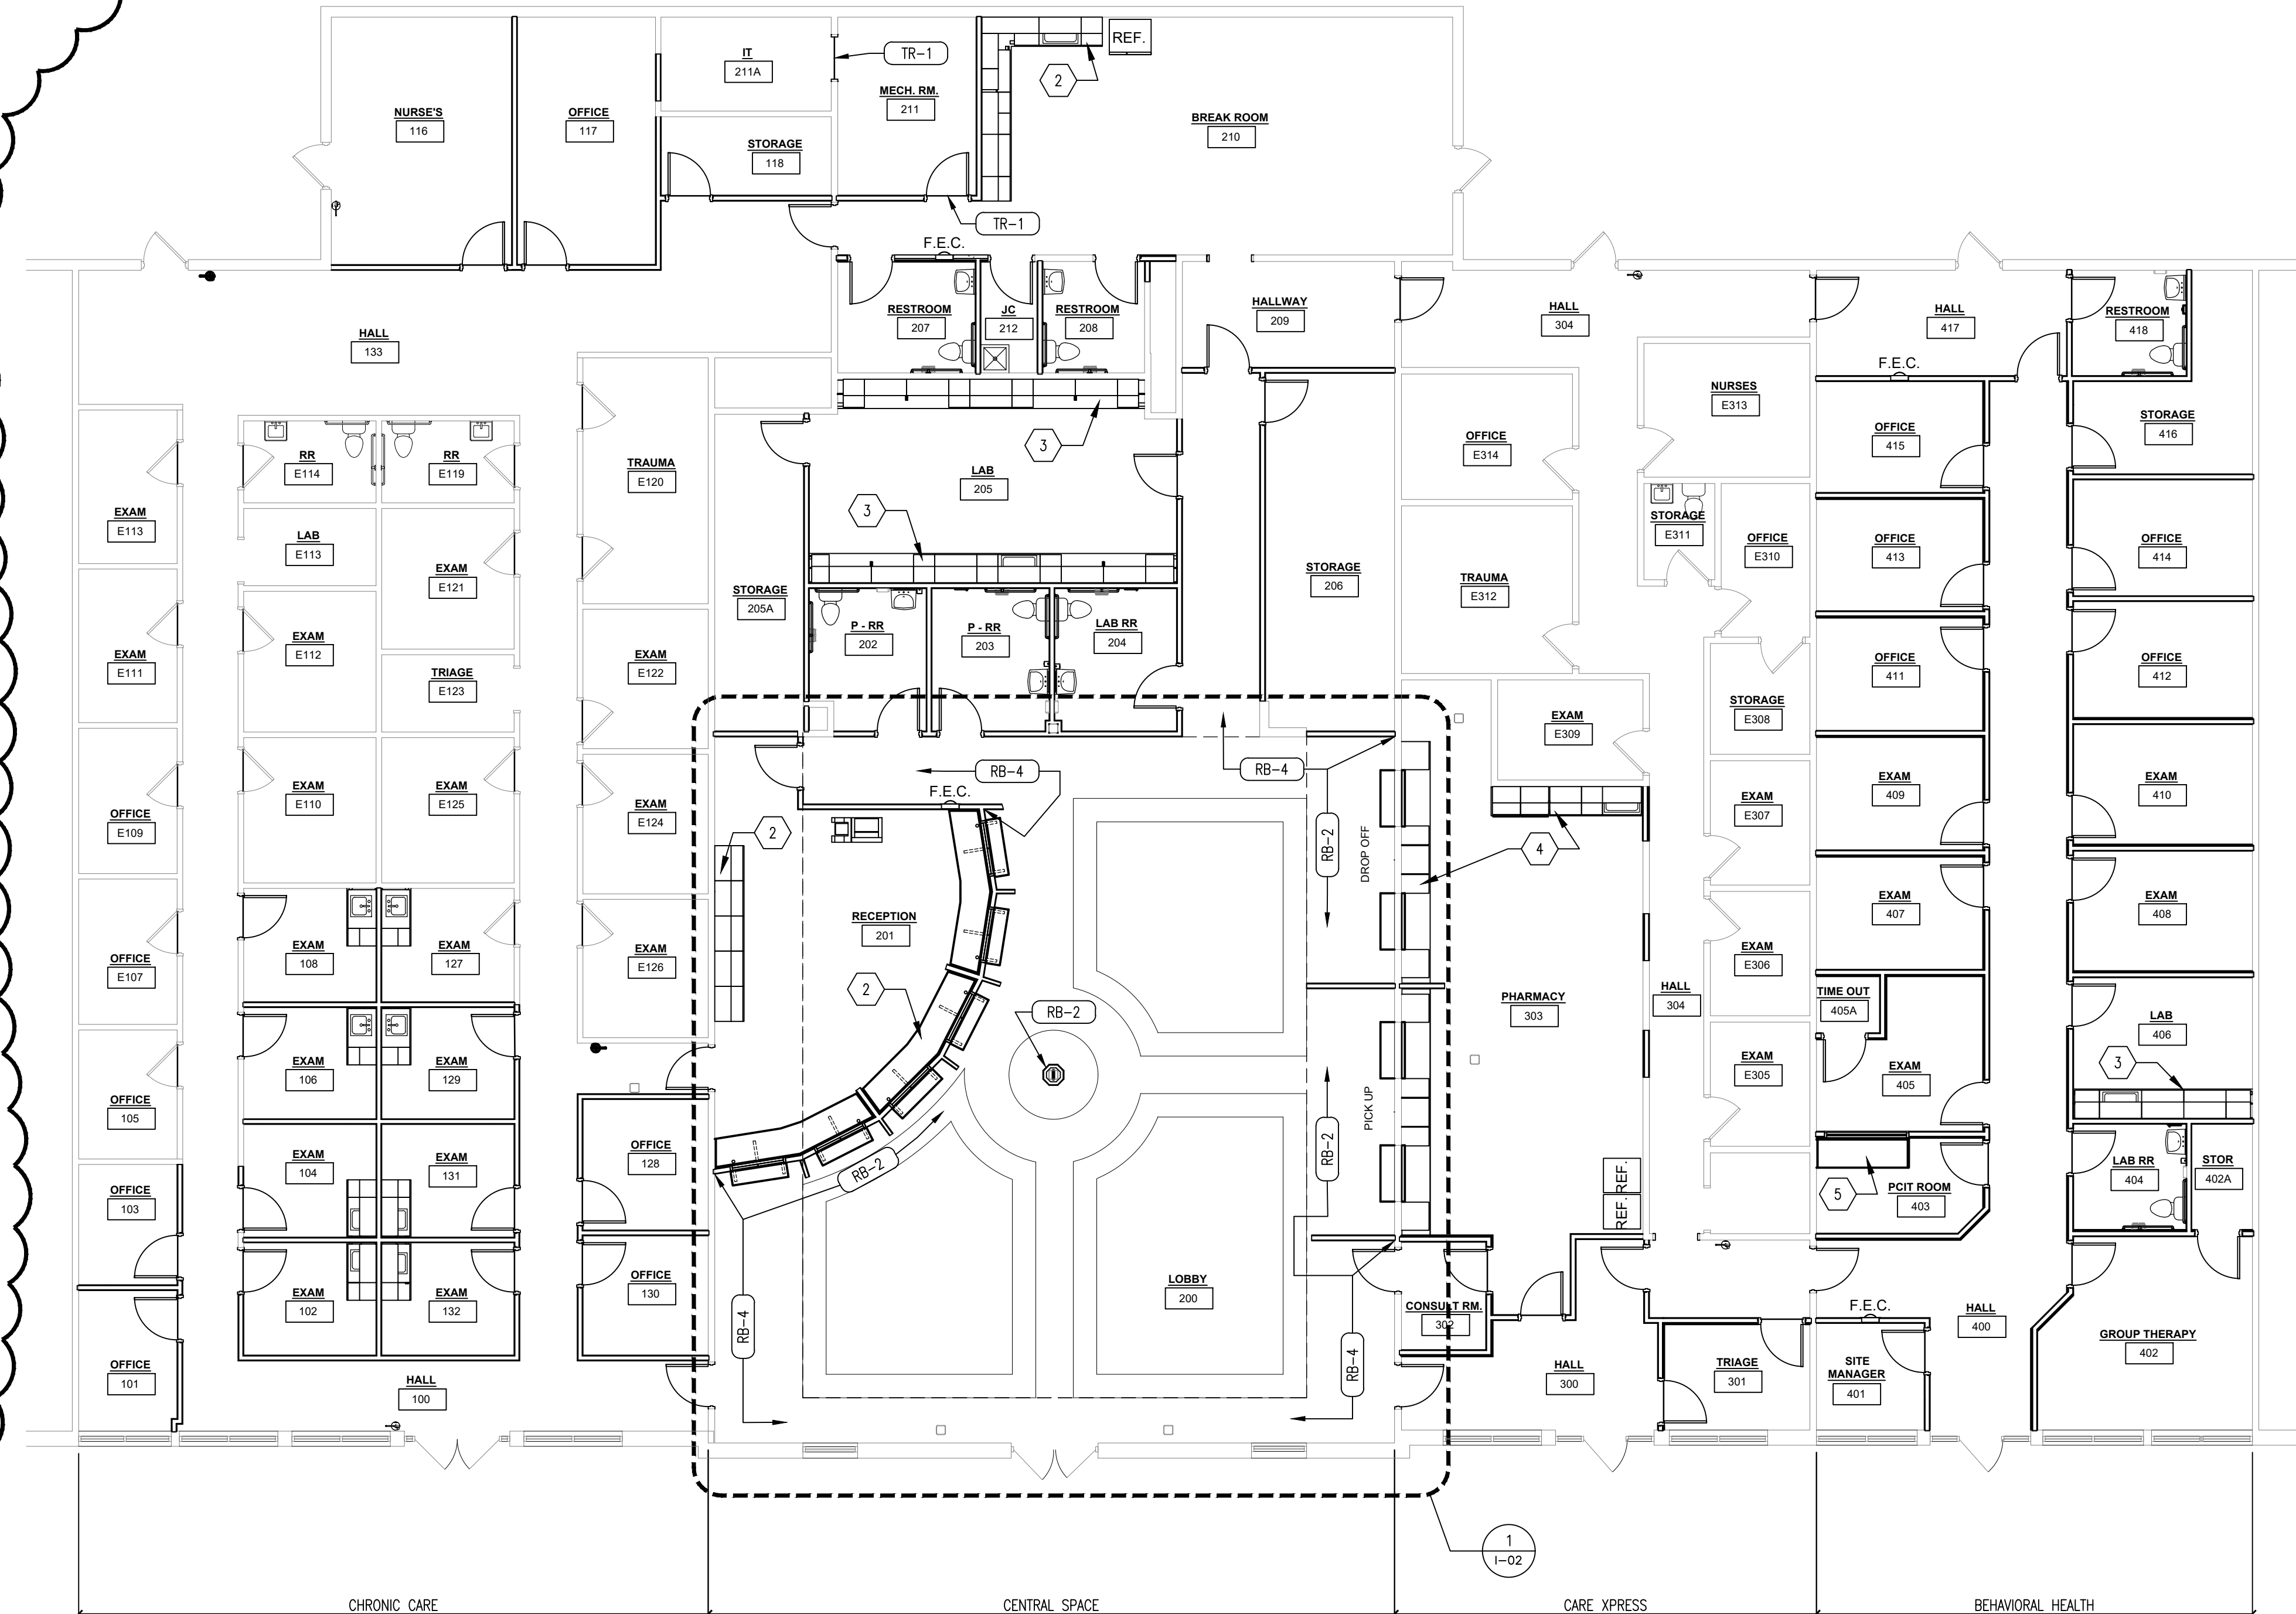

**1 FINISH PLAN**

SCALE: 1/8" = 1'-0"

CONSTRUCTION DOCUMENTS




**GENERAL ROOM FINISH NOTES**

- A. FLOOR FINISH CONTINUES UNDER ALL OPEN COUNTERS, CASEWORK, FURNITURE, FIXTURES AND EQUIPMENT. FLOOR PATTERNS ON THE DRAWINGS ARE SHOWN FOR VISUAL CLARITY ONLY.
- B. WHERE FLOOR MATERIAL CHANGES IN DOORWAYS, PLACE TRANSITION UNDERNEATH DOOR LEAF.
- C. REFER TO REFLECTED CEILING PLAN FOR CEILING TILE SPECIFICATION, LOCATION OF GWB SOFFITS, ETC.


**KEYED FINISH NOTES**

- 1 ARTIFICIAL MAPLE TREES BY OWNER AND INSTALLED BY CONTRACTOR. EACH WILL BE 13'-0" TALL WITH A 10'-0" CANOPY SPREAD IN A WEIGHTED POT.
- 2 PLAM-1 COUNTERTOP AND WALL CABINETS.  
PLAM-2 BASE CABINETS.
- 3 PLAM-3 COUNTERTOP AND WALL CABINETS  
PLAM-4 BASE CABINETS
- 4 PLAM-3 COUNTERTOP AND WALL CABINETS  
PLAM-2 BASE CABINETS
- 5 PLAM-4 COUNTER

INTERIOR FINISH LEGEND			
CODE	MATERIAL	MANUFACTURER / STYLE	DESCRIPTION / COLOR
CONTACT: NAOMI ROFLOW / NAOMI.ROFLOW@INTERFACE.COM / (513) 720-5870			
LVT-1	LUXURY VINYL TILE (25CM x 1M)	INTERFACE - CACTUS MAKES PERFECT INSTALLATION: ASHLAR, ZERO VOC ADHESIVE	A02101 DESERT SAND
LVT-2	LUXURY VINYL TILE (50CM x 50CM)	INTERFACE - ARIES INSTALLATION: NON-DIRECTIONAL, ZERO VOC ADHESIVE	A01812 DARK GREEN
LVT-3	LUXURY VINYL TILE (50CM x 50CM)	INTERFACE - ARIES INSTALLATION: NON-DIRECTIONAL, ZERO VOC ADHESIVE	A01810 KELLY GREEN
LVT-4	LUXURY VINYL TILE (50CM x 50CM)	INTERFACE - WALK OF LIFE INSTALLATION: NON-DIRECTIONAL, ZERO VOC ADHESIVE	A01201 WARM ASH
LVT-5	LUXURY VINYL TILE (50CM x 50CM)	INTERFACE - SCORPIO INSTALLATION: NON-DIRECTIONAL, ZERO VOC ADHESIVE	A01714 MUSHROOM
LVT-6	LUXURY VINYL TILE (25CM x 1M)	INTERFACE - NATURAL WOODGRAINS INSTALLATION: ASHLAR, ZERO VOC ADHESIVE	A00207 WASHED WHEAT
CONC	SEALED CONCRETE		
P-1	FIELD PAINT	SHERWIN-WILLIAMS - ZERO VOC EGGSHELL	SW 7105 PAPERWHITE
P-2	ACCENT PAINT	SHERWIN-WILLIAMS - ZERO VOC EGGSHELL	SW 2828 COLONIAL REVIVAL TAN
P-3	ACCENT PAINT	SHERWIN-WILLIAMS - ZERO VOC EGGSHELL	SW 2839 ROYCROFT COPPER RED
P-4	ACCENT PAINT	SHERWIN-WILLIAMS - ZERO VOC EGGSHELL	SW 2833 ROYCROFT VELLUM
P-5	ACCENT PAINT	SHERWIN-WILLIAMS - ZERO VOC EGGSHELL	SW 2863 POWDER BLUE
P-6	ACCENT PAINT	SHERWIN-WILLIAMS - ZERO VOC EGGSHELL	SW 2865 CLASSIC YELLOW
P-7	ACCENT PAINT	SHERWIN-WILLIAMS - ZERO VOC EGGSHELL	SW 2832 COLONIAL REVIVAL GRAY
P-8	ACCENT PAINT	SHERWIN-WILLIAMS - ZERO VOC EGGSHELL	SW 2823 ROOKWOOD CLAY
P-9	ACCENT PAINT	SHERWIN-WILLIAMS - ZERO VOC EGGSHELL	SW 2854 CARIBBEAN CORAL
P-10	ACCENT PAINT	SHERWIN-WILLIAMS - ZERO VOC EGGSHELL	SW 2819 DOWNING SLATE
P-11	ACCENT PAINT	SHERWIN-WILLIAMS - ZERO VOC EGGSHELL	SW 6990 CAVIAR
P-12	H.M. FRAMES PAINT	SHERWIN-WILLIAMS - ZERO VOC SEMI-GLOSS	SW 7568 NEUTRAL GROUND
P-13	CEILING PAINT	SHERWIN-WILLIAMS - ZERO VOC FLAT	WHITE
PLAM-1	PLASTIC LAMINATE (COUNTERTOPS & UPPERS)	PIONITE	TRAVELIN' LIGHT AT680-SD
PLAM-2	PLASTIC LAMINATE (BASE CABINETS)	NEVAMAR	EASY ELEGANCE VA5002T
PLAM-3	PLASTIC LAMINATE (COUNTERTOPS & UPPERS)	PIONITE	PALIO PAPEI AV981-SD
PLAM-4	PLASTIC LAMINATE (BASE CABINETS)	NEVAMAR	STRING S6052T
RB-1	4" RUBBER COVE BASE	TARKETT / JOHNSONITE	22 PEARL
RB-2	6" RUBBER COVE BASE	TARKETT / JOHNSONITE	40 BLACK
RB-3	4" RUBBER COVE BASE	TARKETT / JOHNSONITE	20 CHARCOAL
RB-4	6" RUBBER COVE BASE	TARKETT / JOHNSONITE	45 SANDALWOOD
SS-1	SOLID SURFACE MATERIAL	LG HI-MACS	G031 BLACK GRANITE
TR-1	LVT-TO-CONCRETE REDUCER STRIP	TARKETT / JOHNSONITE SSR-XX-B	29 MOON ROCK
SH-1	SHINGLE SIDING	JAMES HARDIE STRAIGHT EDGE PANEL	IRON GRAY
SEE TYPICAL PATTERN ELEVATIONS ON SHEET I-01			
MDF-1	CARVED MDF WALL PANELS - STUCCO	BOLTON DESIGN BUILD	P-2 SW 2828 COLONIAL REVIVAL TAN
MDF-2	CARVED MDF WALL PANELS - STONE	BOLTON DESIGN BUILD	P-2 SW 2828 COLONIAL REVIVAL TAN
MDF-3	CARVED MDF WALL PANELS - BRICK	BOLTON DESIGN BUILD	P-3 SW 2839 ROYCROFT COPPER RED
MDF-4	CARVED MDF WALL PANELS - STUCCO	BOLTON DESIGN BUILD	P-4 SW 2833 ROYCROFT VELLUM
MDF-5	CARVED MDF WALL PANELS - STUCCO	BOLTON DESIGN BUILD	P-5 SW 2863 POWDER BLUE
MDF-6	CARVED MDF WALL PANELS - STUCCO	BOLTON DESIGN BUILD	P-6 SW 2865 CLASSIC YELLOW
MDF-7	CARVED MDF WALL PANELS - BOARD & BATTEN	BOLTON DESIGN BUILD	P-7 SW 2832 COLONIAL REVIVAL GRAY
MDF-8	CARVED MDF WALL PANELS - BOARD & BATTEN	BOLTON DESIGN BUILD	P-8 SW 2823 ROOKWOOD CLAY
MDF-9	CARVED MDF WALL PANELS - BRICK	BOLTON DESIGN BUILD	P-9 SW 2854 CARIBBEAN CORAL

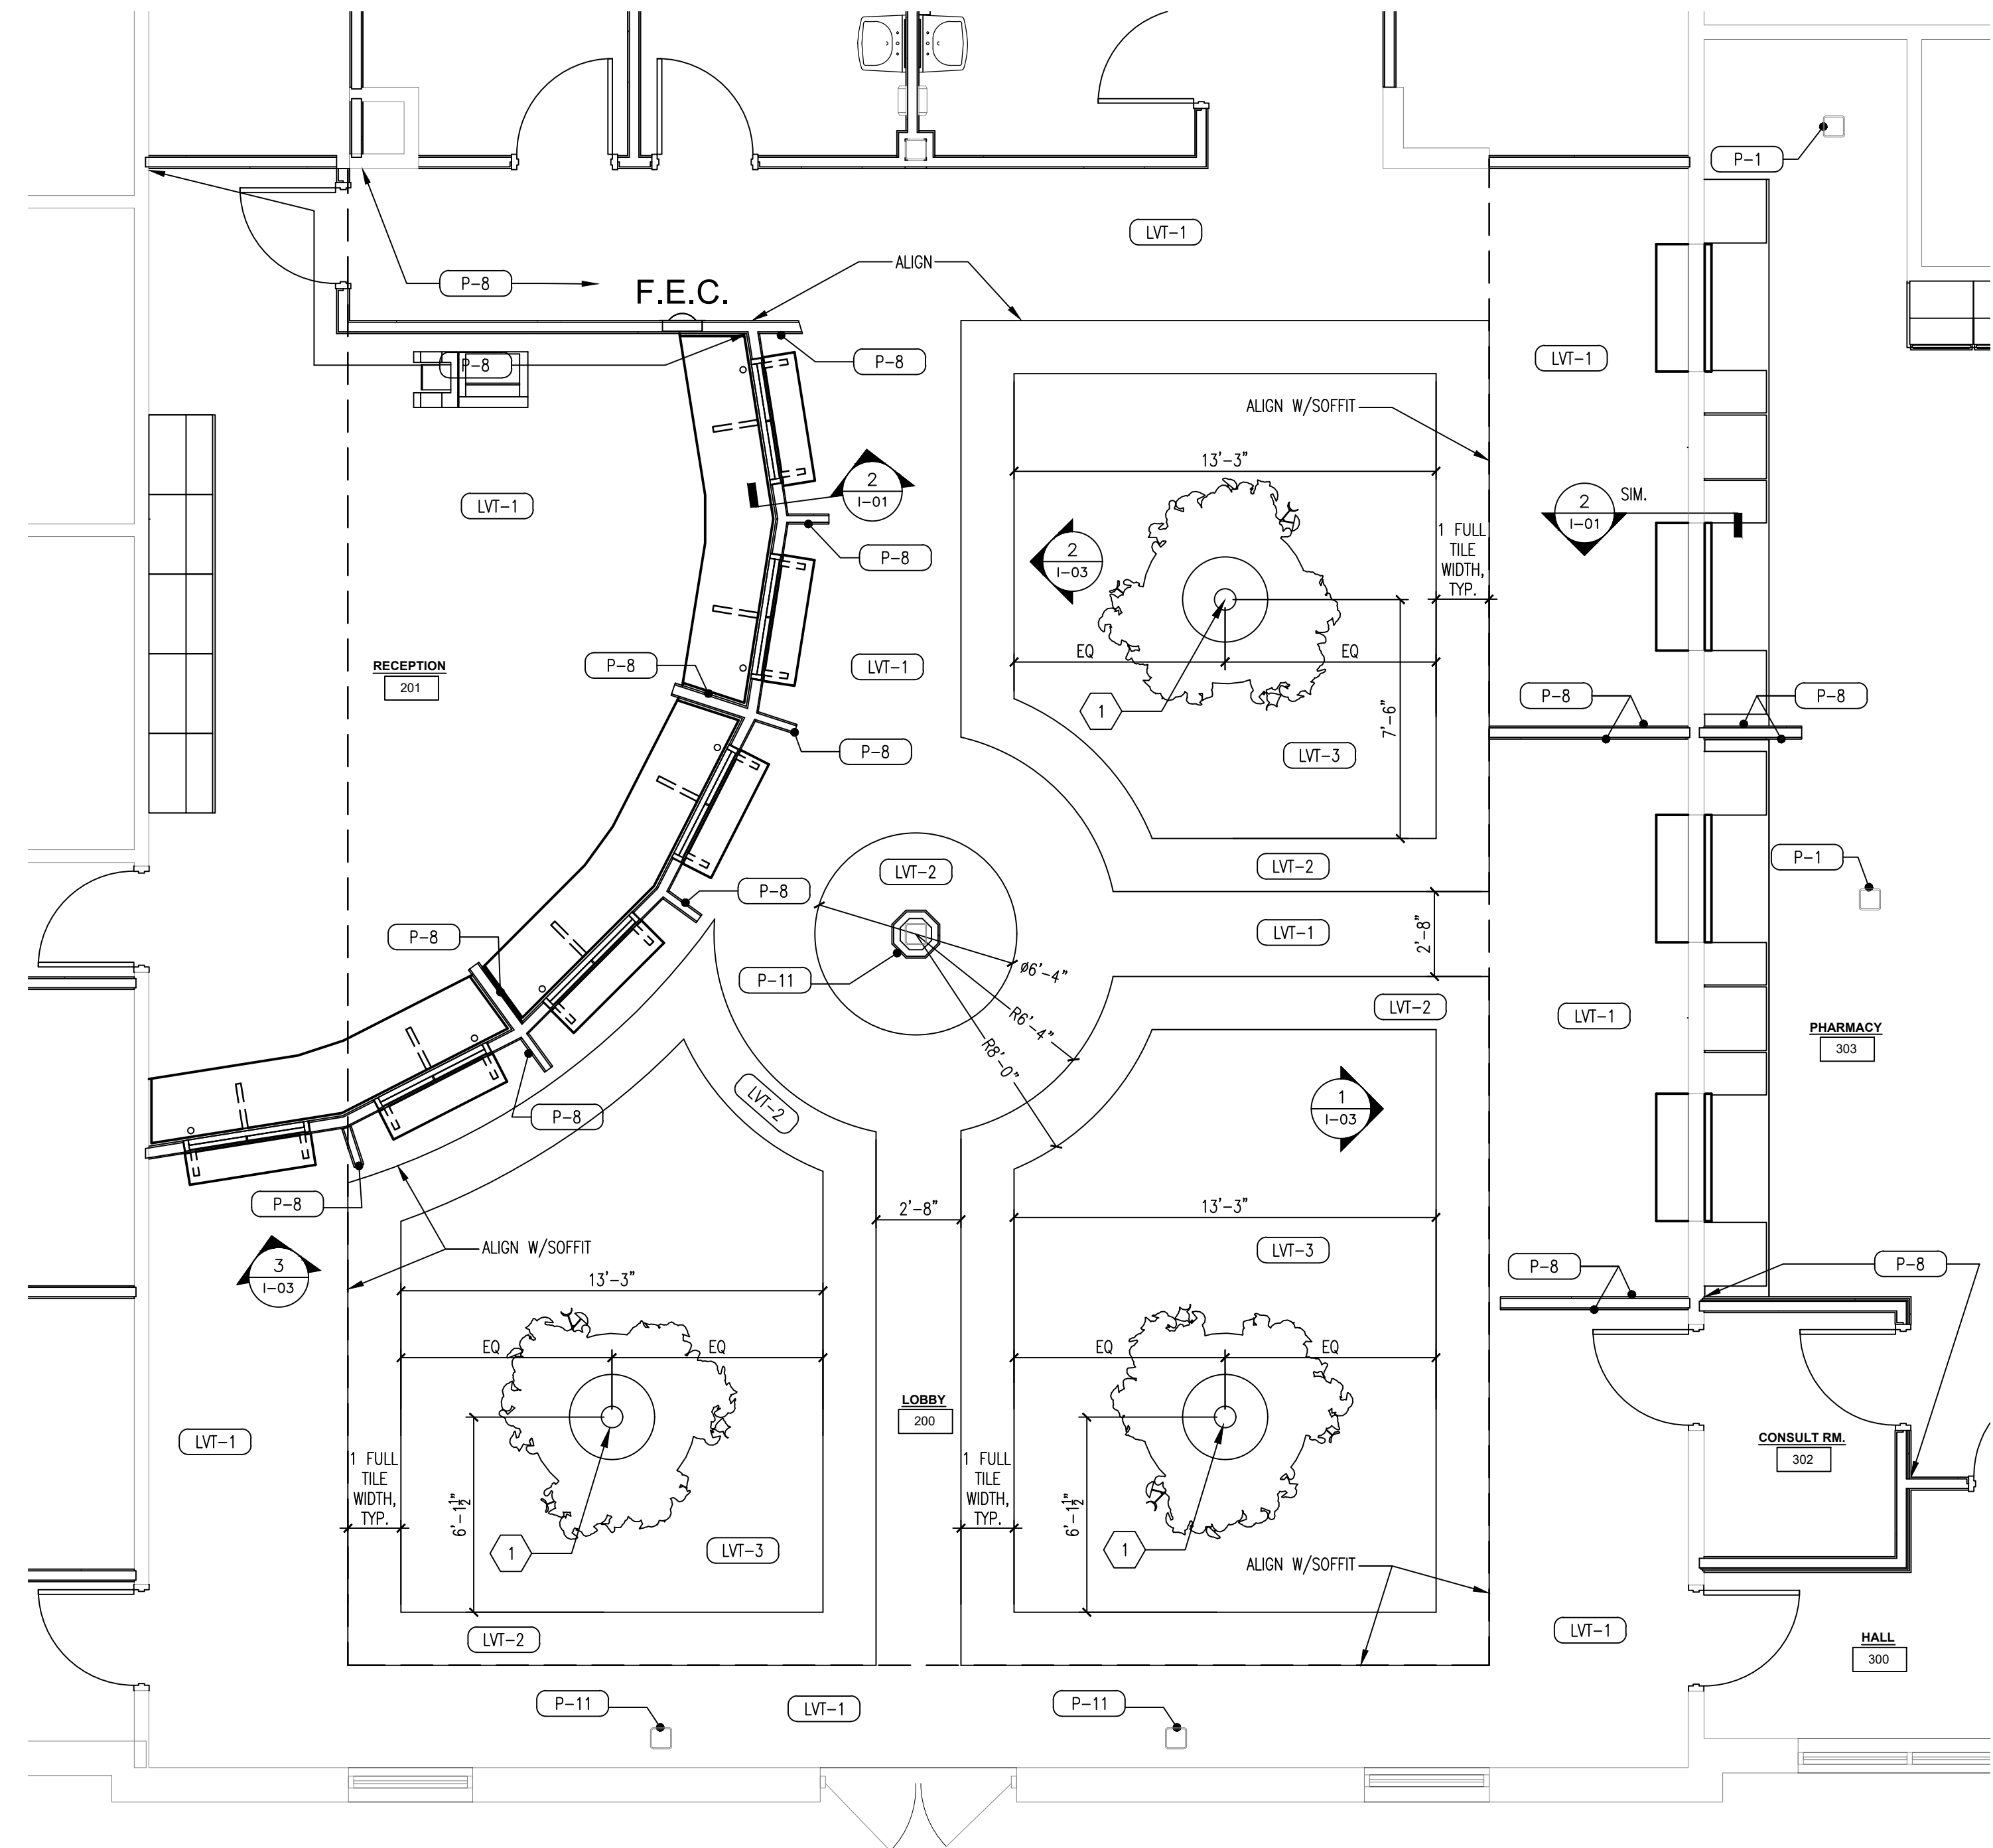


1 ENLARGED FINISH PLAN  
SCALE: 3/4" = 1'-0"

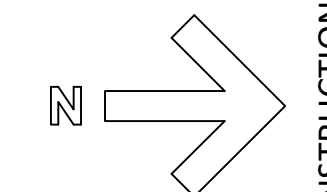


CONSTRUCTION DOCUMENTS

ROOM FINISH SCHEDULE										
ROOM NO.	ROOM NAME	FLOOR		BASE		WALLS				REMARKS
		MAT'L.	FINISH	MAT'L.	FINISH	NORTH	EAST	SOUTH	WEST	
300	HALL	LVT	1	RB	1	P-1	P-1	P-1	P-1	-
301	TRIAGE	LVT	5	RB	3	P-5	P-1	P-1	P-1	-
302	CONSULT. RM.	LVT	5	RB	3	P-1	P-1	P-1	P-8	-
303	PHARMACY	LVT	5	RB	3	P-1	P-1	P-1	P-1	-
304	HALL	LVT	5	RB	1	P-1	P-1	P-1	P-1	-
E305	EXAM	LVT	5	RB	3	P-5	P-1	P-1	P-1	-
E306	EXAM	LVT	5	RB	3	P-5	P-1	P-1	P-1	-
E307	EXAM	LVT	5	RB	3	P-5	P-1	P-1	P-1	-
E308	STORAGE	LVT	5	RB	1	P-1	P-1	P-1	P-1	-
E309	EXAM	LVT	5	RB	3	P-1	P-1	P-5	P-1	-
E310	OFFICE	LVT	5	RB	3	P-6	P-1	P-1	P-1	-
E311	STORAGE	LVT	5	RB	1	P-1	P-1	P-1	P-1	-
E312	TRAUMA	LVT	5	RB	3	P-1	P-1	P-5	P-1	-
E313	NURSES	LVT	5	RB	1	P-1	P-1	P-1	P-1	-
E314	OFFICE	LVT	5	RB	3	P-1	P-1	P-6	P-1	-
400	HALL	LVT	1	RB	1	P-1	P-1	P-1	P-1	-
401	SITE MANAGER	LVT	6	RB	3	P-1	P-1	P-6	P-1	-
402	GROUP THERAPY	LVT	6	RB	3	P-6	P-1	P-1	P-1	-
402A	STOR.	LVT	6	RB	1	P-1	P-1	P-1	P-1	-
403	PCIT ROOM	LVT	6	RB	1	P-1	P-1	P-1	P-1	-
404	LAB RR	LVT	6	RB	3	P-1	P-1	P-1	P-1	-
405	EXAM	LVT	6	RB	3	P-1	P-5	P-1	P-1	-
405A	TIME OUT	LVT	6	RB	1	P-1	P-1	P-1	P-1	-
406	LAB	LVT	6	RB	1	P-1	P-1	P-1	P-1	-
407	EXAM	LVT	6	RB	3	P-1	P-5	P-1	P-1	-
408	EXAM	LVT	6	RB	3	P-1	P-5	P-1	P-1	-
409	EXAM	LVT	6	RB	3	P-1	P-1	P-1	P-5	-
410	EXAM	LVT	6	RB	3	P-1	P-1	P-1	P-5	-
411	OFFICE	LVT	6	RB	3	P-1	P-5	P-1	P-1	-
412	OFFICE	LVT	6	RB	3	P-1	P-5	P-1	P-1	-
413	OFFICE	LVT	6	RB	3	P-1	P-1	P-1	P-5	-
414	OFFICE	LVT	6	RB	3	P-1	P-1	P-1	P-5	-
415	OFFICE	LVT	6	RB	3	P-1	P-1	P-1	P-5	-
416	STORAGE	LVT	6	RB	1	P-1	P-1	P-1	P-1	-
417	HALL	LVT	1	RB	1	P-1	P-1	P-1	P-1	-
418	RESTROOM	LVT	6	RB	1	P-1	P-1	P-1	P-1	-


ROOM FINISH SCHEDULE										
ROOM NO.	ROOM NAME	FLOOR		BASE		WALLS				REMARKS
		MAT'L.	FINISH	MAT'L.	FINISH	NORTH	EAST	SOUTH	WEST	
100	HALL	LVT	1	RB	1	P-1	P-1	P-1	P-1	-
101	OFFICE	LVT	4	RB	3	P-1	P-1	P-9	P-1	-
102	EXAM	LVT	4	RB	3	P-7	P-1	P-1	P-1	NEW CASEWORK TO MATCH EXISTING
103	OFFICE	LVT	4	RB	3	P-1	P-1	P-9	P-1	-
104	EXAM	LVT	4	RB	3	P-7	P-1	P-1	P-1	NEW CASEWORK TO MATCH EXISTING
105	OFFICE	LVT	4	RB	3	P-1	P-1	P-9	P-1	-
106	EXAM	LVT	4	RB	3	P-7	P-1	P-1	P-1	NEW CASEWORK TO MATCH EXISTING
E107	OFFICE	LVT	4	RB	3	P-1	P-1	P-9	P-1	-
108	EXAM	LVT	4	RB	3	P-7	P-1	P-1	P-1	NEW CASEWORK TO MATCH EXISTING
E109	OFFICE	LVT	4	RB	3	P-1	P-1	P-9	P-1	-
E110	EXAM	LVT	4	RB	3	P-7	P-1	P-1	P-1	-
E111	EXAM	LVT	4	RB	3	P-1	P-1	P-7	P-1	-
E112	EXAM	LVT	4	RB	3	P-7	P-1	P-1	P-1	-
E113	EXAM	LVT	4	RB	3	P-1	P-1	P-7	P-1	-
E114	RR	LVT	4	RB	3	P-1	P-1	P-1	P-10	-
E115	LAB	LVT	4	RB	1	P-1	P-1	P-1	P-1	-
116	NURSE'S	LVT	4	RB	1	P-1	P-1	P-1	P-1	-
117	OFFICE	LVT	4	RB	3	P-1	P-1	P-1	P-9	-
118	STORAGE	LVT	4	RB	1	P-1	P-1	P-1	P-1	-
E119	RR	LVT	4	RB	3	P-1	P-1	P-1	P-10	-
E120	TRAUMA	LVT	4	RB	3	P-7	P-1	P-1	P-1	-
E121	EXAM	LVT	4	RB	3	P-1	P-1	P-7	P-1	-
E122	EXAM	LVT	4	RB	3	P-7	P-1	P-1	P-1	-
E123	TRIAGE	LVT	1	RB	1	P-1	P-1	P-1	P-1	-
E124	EXAM	LVT	4	RB	3	P-1	P-1	P-1	P-1	-
E125	EXAM	LVT	4	RB	3	P-1	P-1	P-7	P-1	-
E126	EXAM	LVT	4	RB	3	P-7	P-1	P-1	P-1	-
127	EXAM	LVT	4	RB	3	P-1	P-1	P-7	P-1	NEW CASEWORK TO MATCH EXISTING
128	OFFICE	LVT	4	RB	3	P-9	P-1	P-1	P-1	-
129	EXAM	LVT	4	RB	3	P-1	P-1	P-7	P-1	NEW CASEWORK TO MATCH EXISTING
130	OFFICE	LVT	4	RB	3	P-9	P-1	P-1	P-1	-
131	EXAM	LVT	4	RB	3	P-1	P-1	P-7	P-1	NEW CASEWORK TO MATCH EXISTING
132	EXAM	LVT	4	RB	3	P-1	P-1	P-7	P-1	NEW CASEWORK TO MATCH EXISTING
133	HALL	LVT	1	RB	1	P-1	P-1	P-1	P-1	-
200	LOBBY	LVT	1,2,3	RB	2,4	SEE FINISH PLAN & ELEVATIONS				SEE ENLARGED FINISH PLAN
201	RECEPTION	LVT	1	RB	3	P-1	P-1	P-1	P-8	-
202	P-RR	LVT	1	RB	1	P-1	P-1	P-1	P-1	-
203	P-RR	LVT	1	RB	1	P-1	P-1	P-1	P-1	-
204	LAB RR	LVT	1	RB	1	P-1	P-1	P-1	P-1	-
205	LAB	LVT	1	RB	1	P-1	P-1	P-1	P-1	-
206	STORAGE	LVT	1	RB	1	P-1	P-1	P-1	P-1	-
207	RESTROOM	LVT	1	RB	1	P-1	P-1	P-1	P-1	-
208	RESTROOM	LVT	1	RB	1	P-1	P-1	P-1	P-1	-
209	HALLWAY	LVT	1	RB	1	P-1	P-1	P-1	P-1	-
210	BREAKROOM	LVT	1	RB	3	P-1	P-1	P-1	P-3	-
211	MECH. RM.	CONC	-	RB	1	P-1	P-1	P-1	P-1	-
211A	IT	LVT	1	RB	1	P-1	P-1	P-1	P-1	-

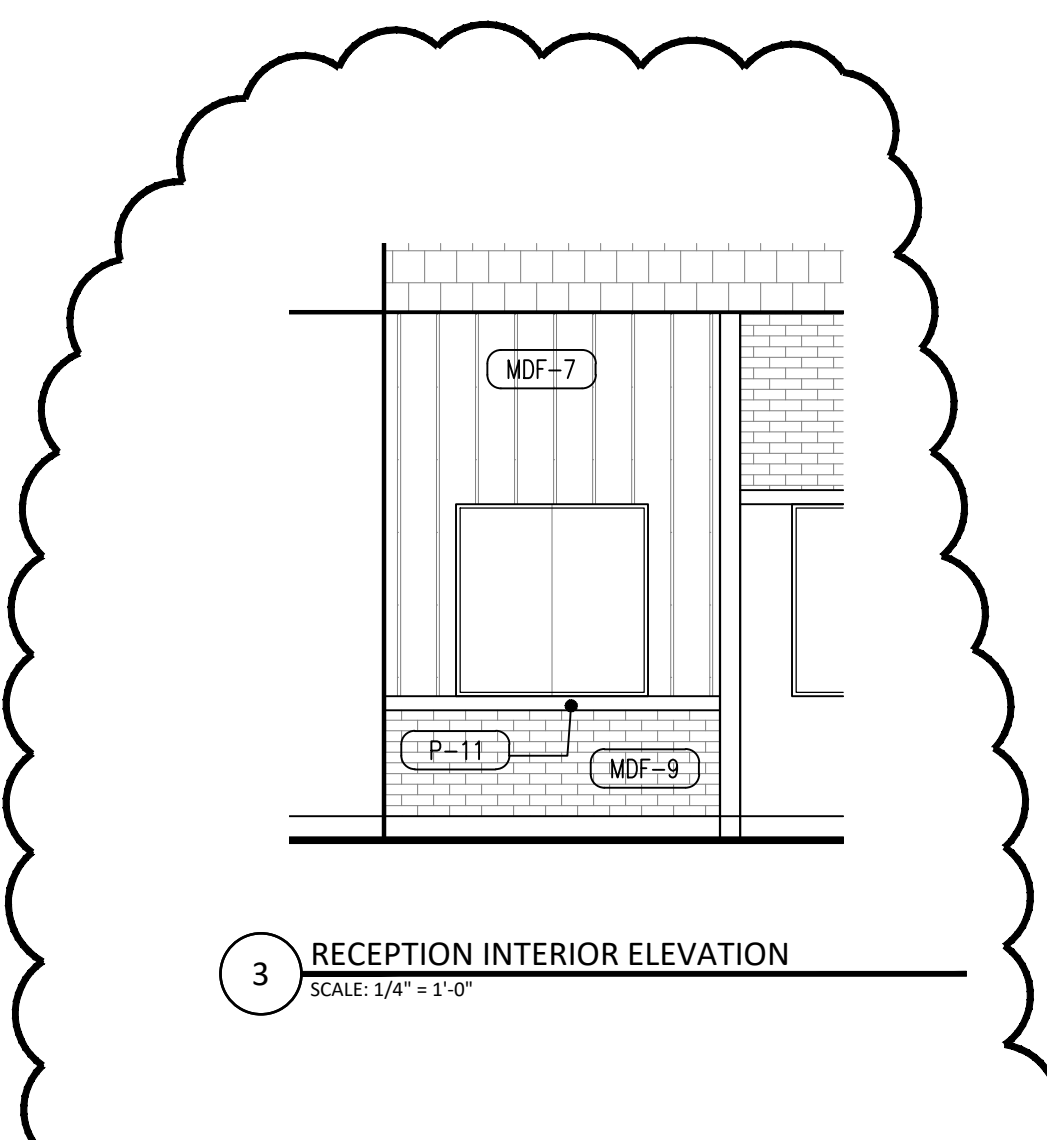

3 RECEPTION INTERIOR ELEVATION  
SCALE: 1/4" = 1'-0"

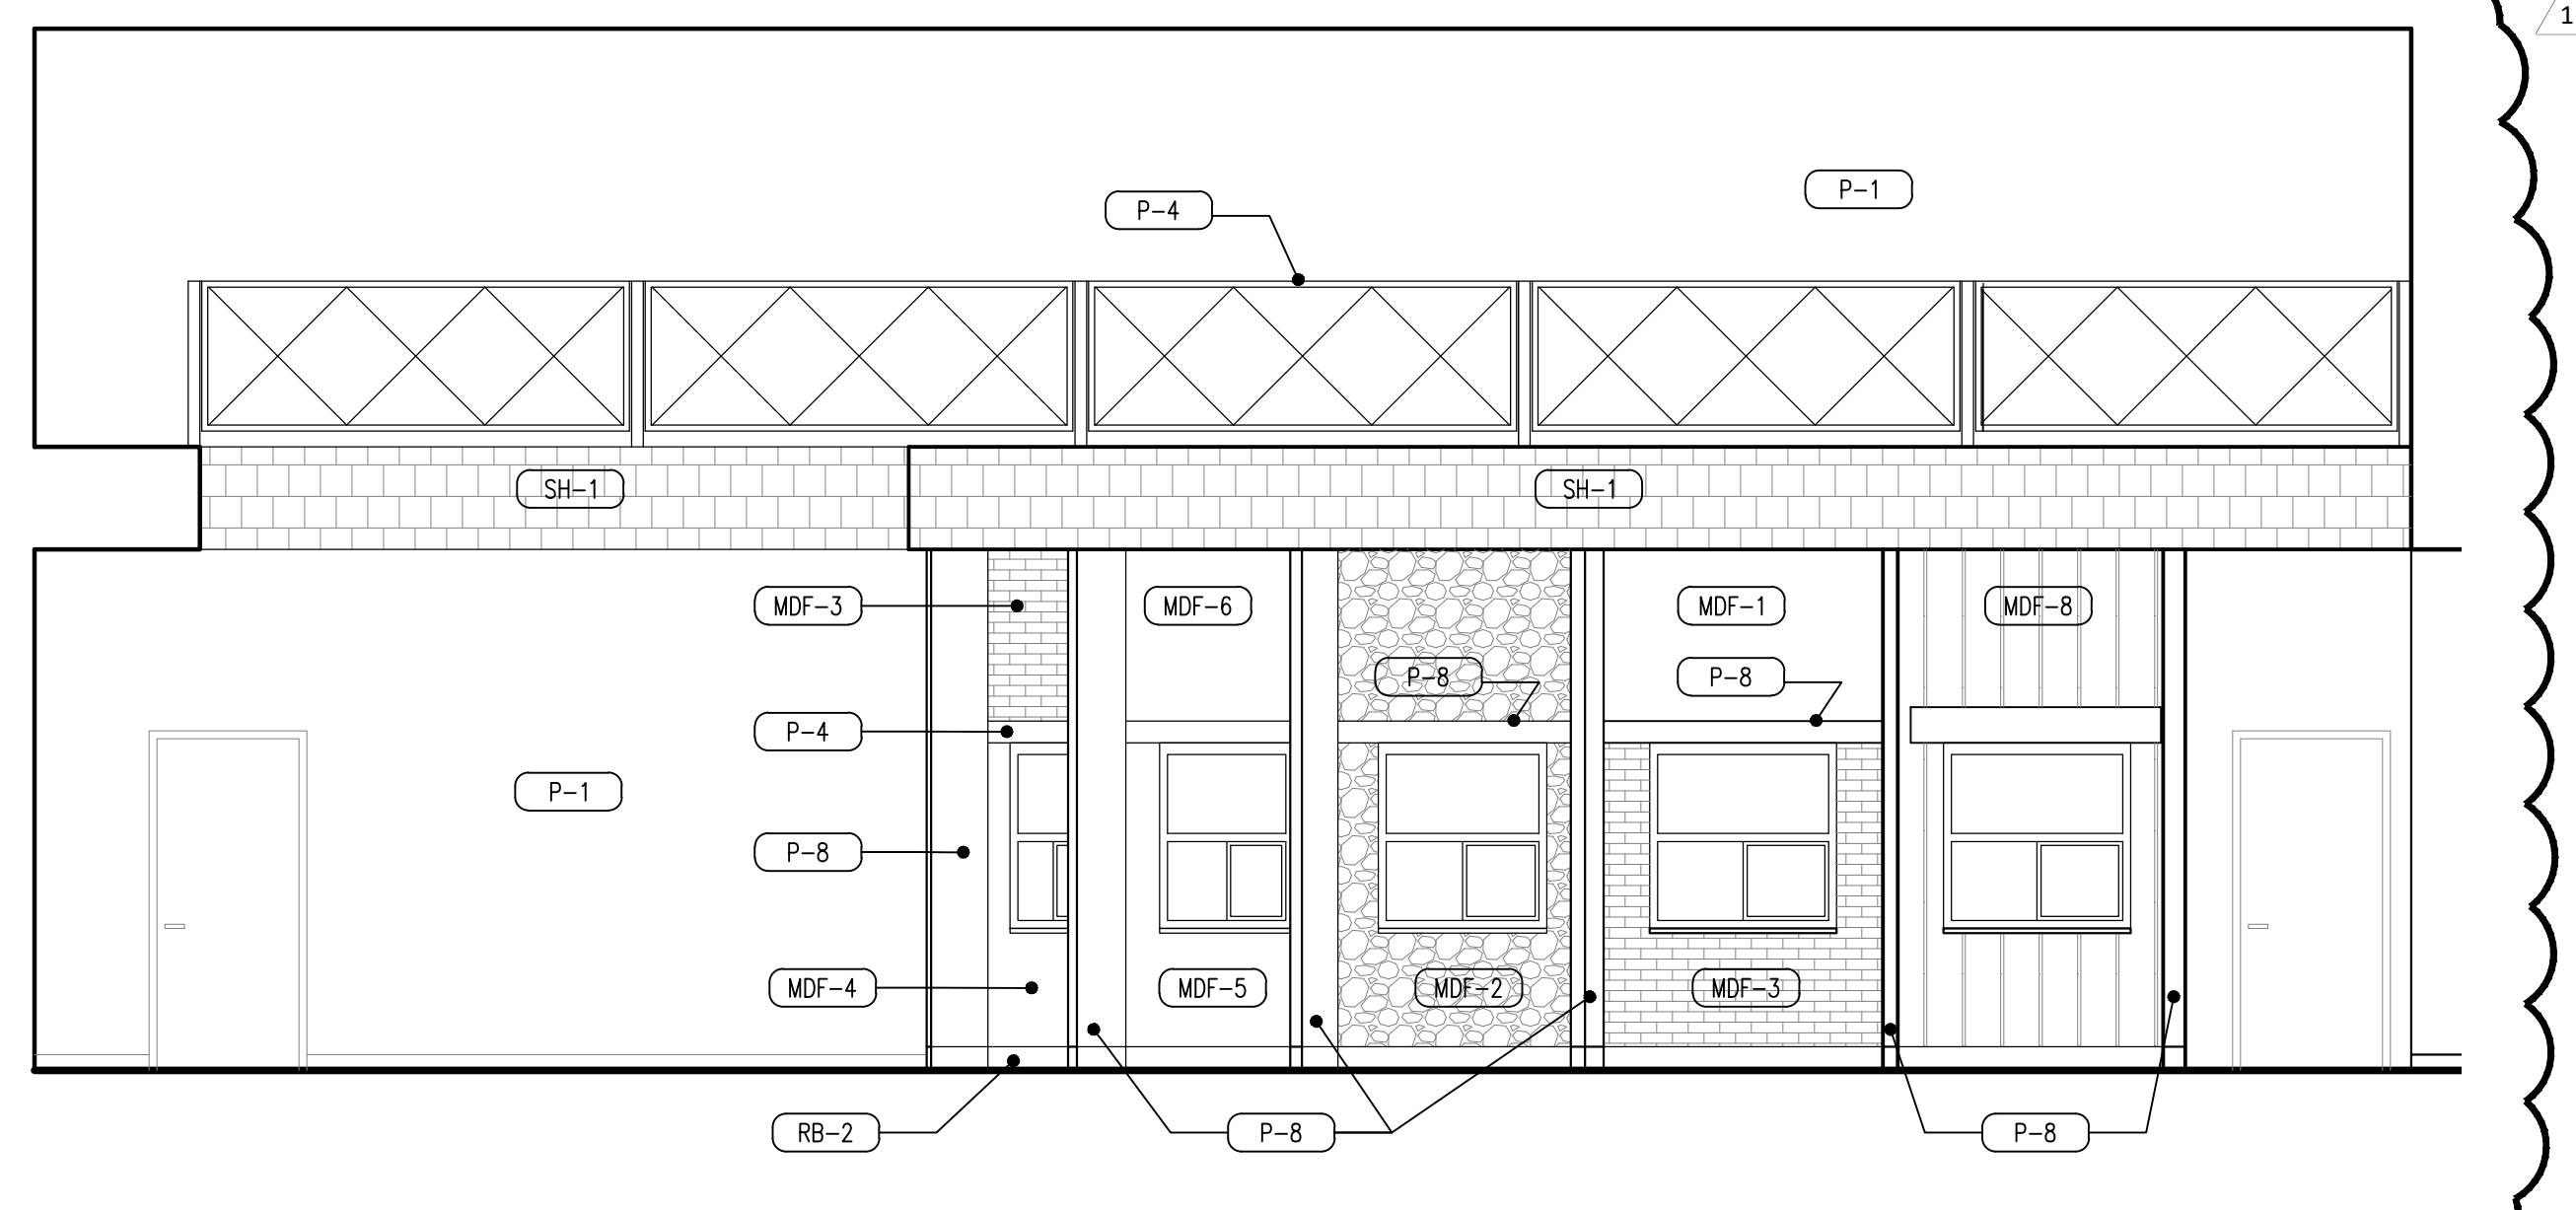

2 RECEPTION INTERIOR ELEVATION  
SCALE: 1/4" = 1'-0"

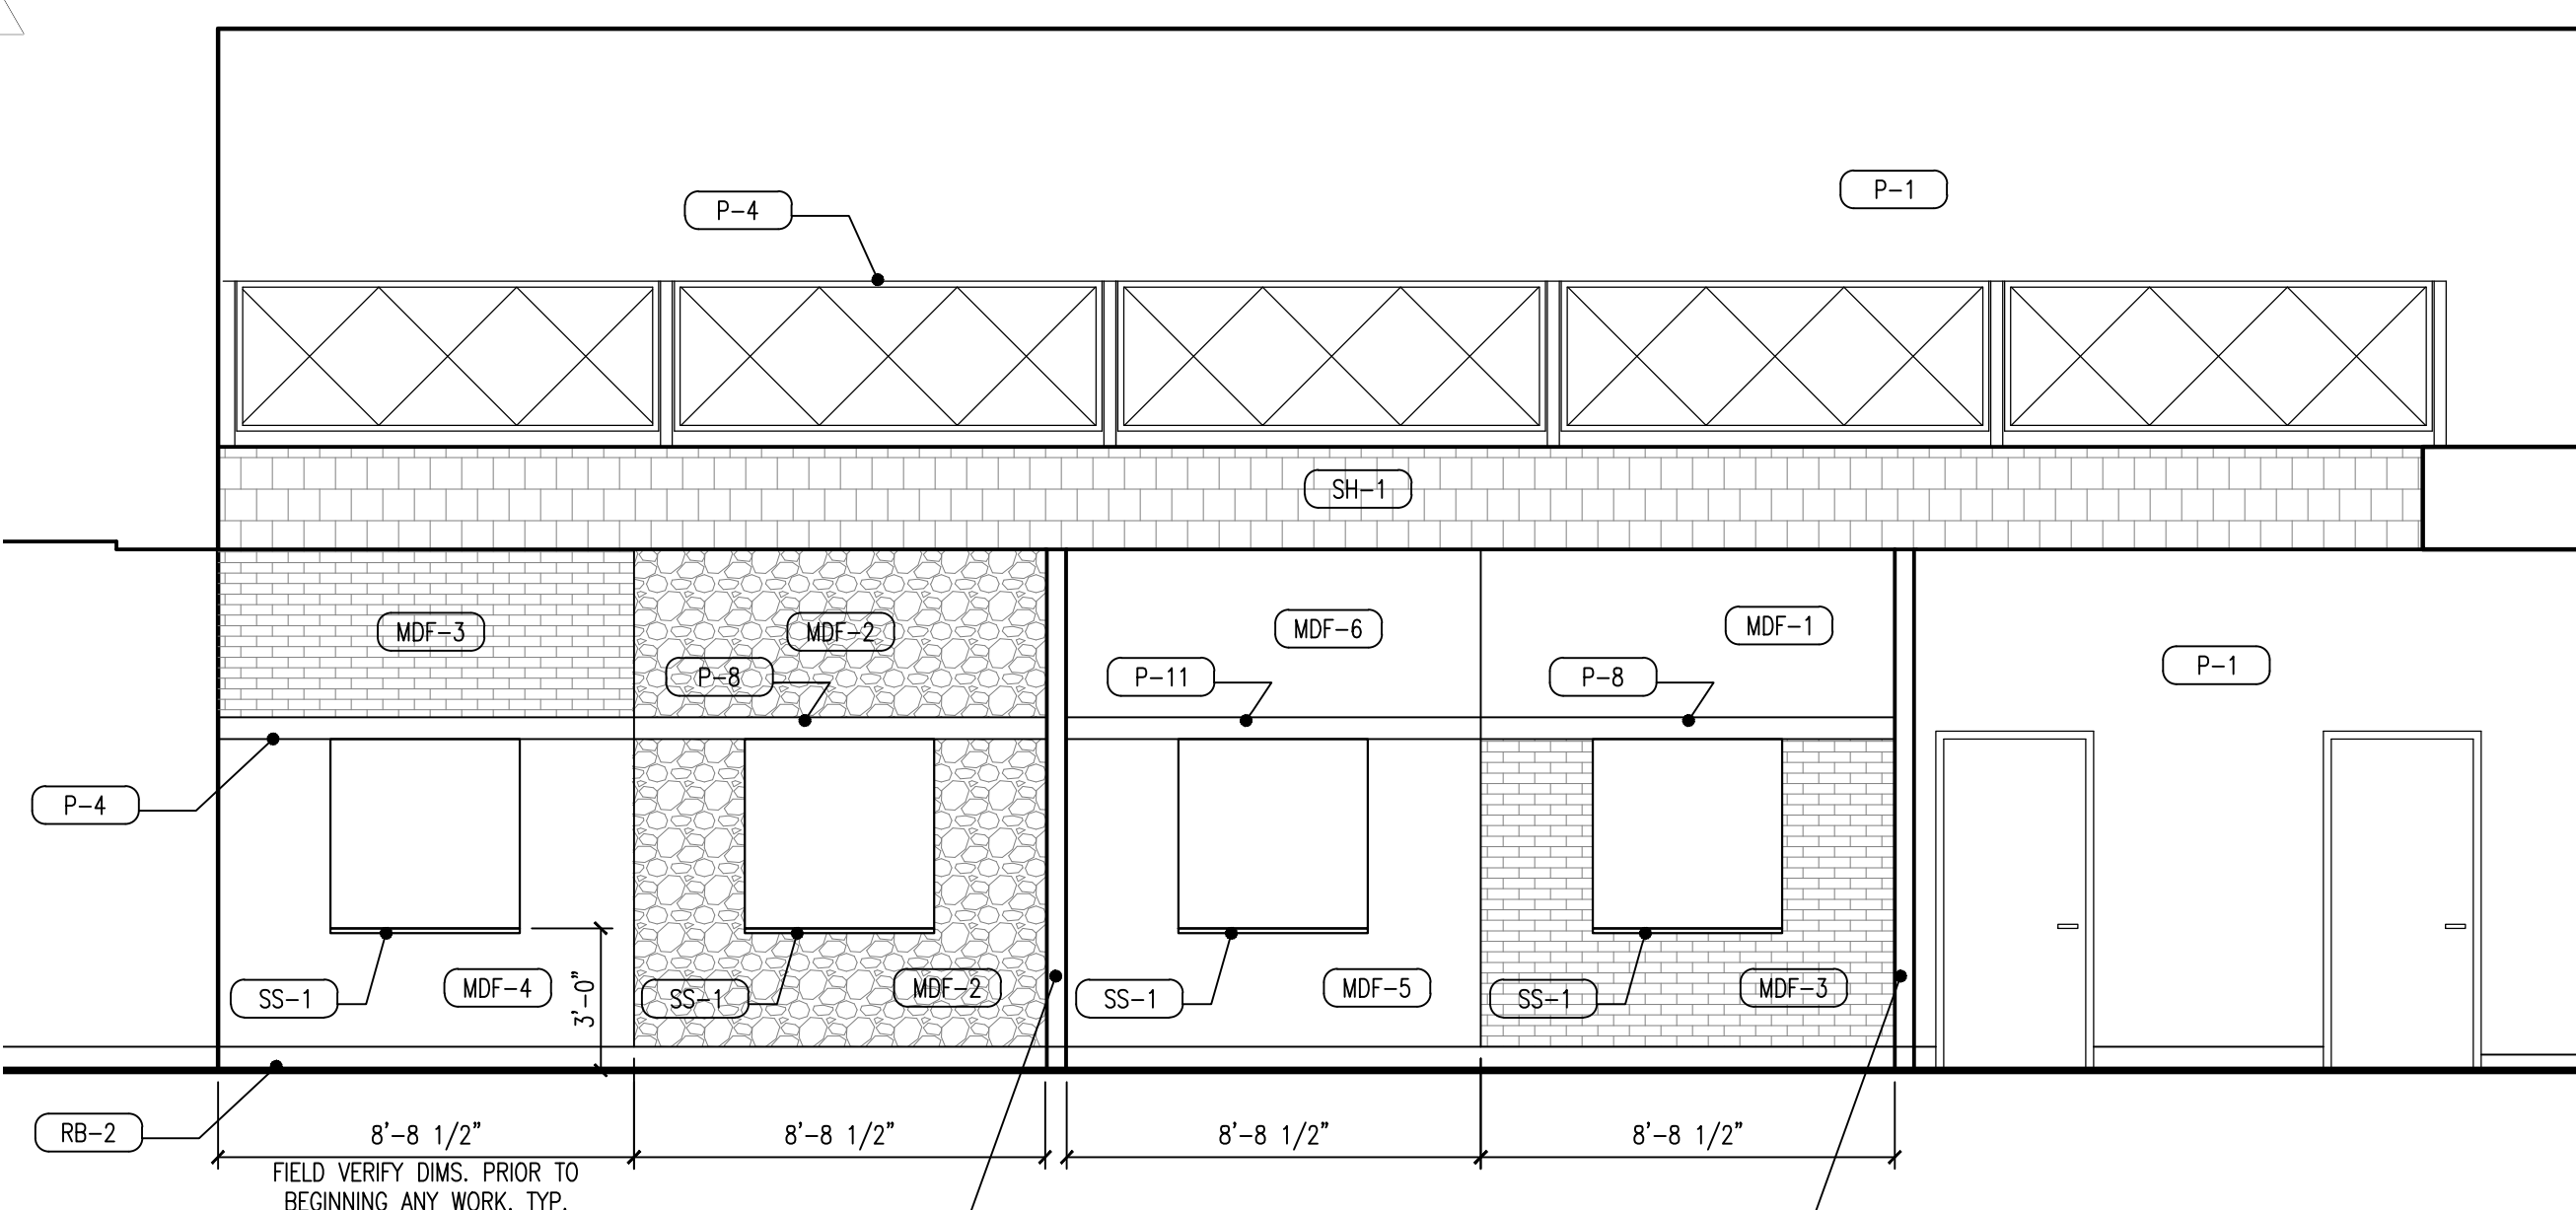

1 PHARMACY INTERIOR ELEVATION  
SCALE: 1/4" = 1'-0"

FIELD VERIFY DIMS. PRIOR TO BEGINNING ANY WORK, TYP.